

Specifications No. C-2530

13-Jun-2018

CUSTOMER : HAWCO

RoHS Compliant

COMPRESSOR SPECIFICATIONS

Compressor type : Scroll Compressor

Refrigerant : R404A, R449A, R1270

Power source : 1PH, 220-240V, 50Hz

Motor type : CSR

Model Name	Nominal Capacity [W]			Motor Rated Output [W] ([HP])	Remark
	R404A	R449A	R1270		
DS1529S1	1500	1275	1495	1500 (2.0)	with CE
DS1836S1	2440	3490	3555	1800 (2.5)	

Packing	Check
Gathered Packing	<input type="checkbox"/>
Separated Packing	<input checked="" type="checkbox"/>

We acknowledge the receipt of this copy.

Please return this compressor specifications after confirming the contents.
 If you do not return this copy by the above date, we will assume that you have checked the contents.

Hitachi-Johnson Controls Air Conditioning, Inc.
 500 Tomita, Ohira-machi, Tochigi-shi, Tochigi-ken 329-4404, Japan

APPD.	CHKD.	DWN.
<i>m. Onoguchi</i>	<i>T. akijama</i>	<i>K. Edigaya</i>

NOTE

The Specifications in this bulletin are subject to change without notice,
 in order that HITACHI may bring the latest innovations to our customers.

SAFETY PRECAUTION

Read and understand all of the safety precautions in this manual before operating the product. These precautions are intended to ensure safe and correct operation of the product and to prevent injury to the operator and other persons and damage to the product. Observe these precautions strictly.

The following symbols indicate the presence of potentially hazardous conditions.

 WARNING	This symbol indicates a potentially hazardous situation which, if not avoided, <u>could result in</u> death or serious injury.
 CAUTION	This symbol indicates a potentially hazardous situation which, if not avoided, <u>may result in</u> minor or moderate injury or property damage accidents to the product. It may also be used to alert against unsafe practices.

The meanings of the graphic symbols in text are shown below.

	<u>Be sure to perform</u> the operation.
	<u>Disconnect</u> the power cable from the electrical outlet.
	<u>Connect</u> the grounding wire.
	<u>Prohibit</u> .

WARNING

-  Provide the refrigerating cycle unit with adequate electrical grounding. Incomplete grounding could result in electrical shock hazards in the event of troubles and current leakage.
-  Connect a fuse or a leak circuit breaker to the main circuit to avoid electrical shock hazards or fire in the event of troubles and current leakage.
-  Check to see that the main power is turned off, before repairing, to avoid electrical shock hazards in case of touching the terminals.
-  Measure the temperature of the hermetic terminals of the compressor and then connect the appropriate lead wires. Lead wire insulation deterioration (thermal deterioration) could result in electrical shock hazards, short-circuiting, or fire.
-  Keep the lead wires away from the surface of the compressor or the piping. Lead wire insulation deterioration (thermal deterioration) could result in electrical shock hazards, short-circuiting, or fire.



Keep the lead wires away from any rotational parts like fans or any vibrational parts like piping.

Lead wire insulation deterioration due to vibration or friction could result in electrical shock hazards, short-circuiting, or fire.



Do NOT make the compressor self-evacuated during operation, which avoids overheating the compressor that could cause burns or fire.



Do NOT touch the surface of the compressor with empty hands, which avoids burns. The surface is very hot during operation and immediately after it has stopped.



Do NOT use this compressor for air compression, which avoids overheating of the compressor that could cause burns or fire.



Do NOT view the inspection window of the compressor for internal observation directly. Use a video camera or other suitable equipment to avoid serious injury owing to explosion of the inspection window or blowout of the refrigerant.



Wear protective goggles during repairs to avoid serious injury owing to explosion of piping or blowout of the refrigerant.

CAUTION



Do NOT install the compressor in a humid place or locations exposed to water. Do NOT dip it into water or spray it with water. In case of using the sound insulation material to enclose the compressor, which is highly hygroscopic, that material must NOT absorb water. Insulation deterioration causes electrical shock hazards, current leakage, short-circuiting, or explosion owing to corrosion.



Attach the specified cover to the hermetic terminals of the compressor by the specified method to prevent entry of dirt.

Incomplete electrical conduction of the hermetic terminals may cause troubles or fire.



Do NOT apply electrical pulse to the compressor while its inside is maintained in a vacuum. It avoids insulation failure inside the compressor, which may result in electrical shock hazards, current leakage, or fire.



Store the compressor in clean and dry environment. Insulation failure of the hermetic terminals of the compressor may result in electrical shock hazards or current leakage. Corrosion of the compressor surface may result in explosion. Blowout of the refrigerant may result in burns.



In case of attaching cluster terminals, the PTC starter, receptacle terminals, or other electrical parts to the hermetic terminals of the compressor, those parts must NOT be obliquely connected or twisted after connections, which avoids reducing fastening force of the terminals. Incomplete electrical conduction of the hermetic terminals may cause troubles or fire.

1. GENERAL SPECIFICATIONS

Model		DS1529S1		DS1836S1		
Nominal Output	HP	2.0		2.5		
	W	1,500		1,800		
Power Supply	-	1 PH, 220-240V, 50 Hz				
Refrigerant	-	R404A, R449A	R1270	R404A, R449A	R1270	
Allowable amount of Refrigerant Charge	g	3000	1320	3000	1320	
Refrigerant Oil	-	POE (VG68)				
Oil Charge	liter	0.85		0.85		
Displacement	cm ³ /rev	29.1		35.7		
	m ³ /h	5.03		6.17		
Rated Revolution	rpm	2,880				
Performance ⁽¹⁾		R404A	R449A	R1270	R404A	R449A
Cooling Capacity	W	1,500	1,275	1,495	2,440	3,490
Power Input	W	1,190	1,130	1,270	2,260	1,800
COP	-	1.26	1.13	1.18	1.08	1.94
Sound Level and Vibration Level ⁽²⁾		R404A	R449A	R1270	R404A	R449A
Sound Level ⁽³⁾	dBA	MAX. 65	MAX. 62	MAX. 62	MAX. 68	MAX. 66
Vibration Level ⁽⁴⁾	μm	MAX. 50	MAX. 45	MAX. 45	MAX. 60	MAX. 60
Net Weight (Including Oil)	kg	22.6			22.9	
Piping ⁽⁵⁾	Suction	-	φ 16.1 I.D. (BR)			
Connection	Discharge	-	φ 9.72 I.D. (BR)			
	Injection	-	φ 6.2 I.D. (BR)			
Motor	Type	-	Capacitor Start and Run (CSR) Permanent Split Motor			
	Poles	-	2			
	Voltage	V	220		220	
	Starting Current	A	46.0		55.4	
	Winding resistance (at 20°C)	Ohm	Main	Aux	Main	Aux
			1.490	2.048	1.299	2.198
Capacitor	Starting Capacitor	-	75μF/400V		75μF / 400V	
	Running Capacitor	-	55μF/450V		55μF / 450V	
Starting Relay	-	AMVL-240V1			AMVL-240V1	

[notes]

(1) Above performance is based on the following conditions

Model	DS1529S1			DS1836S1		
Refrigerant	R404A	R449A	R1270	R404A	R449A	R1270
Evaporating Temperature °C (dew point) (MPa _{abs})	-30 (0.202)	-30 (0.161)	-30 (0.212)	-23.3 (0.267)	-10 (0.360)	-10 (0.428)
Condensing Temperature °C (dew point) (MPa _{abs})	40 (1.811)	40 (1.659)	40 (1.648)	54.4 (2.532)	45 (1.882)	45 (1.843)
Return gas Temperature °C	18	18	18	18.3	20	20
Subcooling K	5	0	0	22.2	0	0
Ambient Temperature °C	32	32	32	32.2	32	32
Compressor Cooling	Fan Cooling + Liquid Injection					

Rated capacity and Rated input are measured by using the equipment including the calorimeter met to

JIS B8606. Minimum allowable capacity is 90% of rated capacity, maximum allowable input is 110% of rated input.

(2) Measurement condition for Sound and Vibration Level.

Model	DS1529S1			DS1836S1		
Refrigerant	R404A	R449A	R1270	R404A	R449A	R1270
Suction Pressure MPa _{abs}	0.202	0.161	0.212	0.433	0.360	0.428
Discharge Pressure MPa _{abs}	1.811	1.659	1.648	2.044	1.882	1.843
Return gas temp. °C			18			
Noise of soundproof room dBA				under 40		
Vibration of soundproof room μm				under 5		
Liquid refrigerant back				No liquid back		
Draft				No draft		

(3) Sound level is measured at the point 30cm away from the compressor surface in a sound measuring room.

(4) Vibration level is measured on the compressor surface.

(5) Connection Type

BR : Brazing, RL : Rotalock, FL : Flange, FR : Flare

(6) Scope of Supply

1) Compressor Assembly Charged with Refrigerant Oil and Nitrogen Gas.

2) The companion connections shall be provided by others.

The other specifications

1. Hermetic terminal : 1/4"quick connect type

2. Space volume of inner shell : 2000 mL

3. Motor Insulation grade : E

4. Approval voltage range rated voltage ±10%

5. Starting performance

The minimum starting voltage shall be as Table 1. (see note 7) under the following conditions.

(1) The starting pressure should be between the suction and discharge of the compressor was balanced and adjusted as shown in the Table 1.

(2) The temperature of compressor case was adjusted to 20 °C or higher at the starting conditions.

Table 1

Starting conditions Motor temperature	Ambient temp.	Pressure [abs]			Minimum starting voltage {V2}
		R404A	R449A	R1270	
Cold-starting Cold state (Room temperature)	20 °C	1.35 MPa	1.22 MPa	1.25 MPa	85% of rated voltage
Hot-starting<Standard> Hot state after operated under standard condition	32.0 °C	1.29 MPa	1.16 MPa	1.20 MPa	85% of rated voltage
Hot-Starting<Overload> Hot state after operated overload condition.	43 °C	1.42 MPa	1.28 MPa	1.31 MPa	90% of rated voltage

[note 7]

The starting voltage (V2) is measured by Hitachi starting test apparatus. It means the accelerable minimum voltage by the accelerating torque between the motor starting torque and the stalling torque, and it is different with the continuous operable voltage (V4) after the reach of maximum speed of motor. (see Fig 1)

As the starting voltage of the product depend on the structure and design of the product, you should measure the starting voltage of the product and you should confirm it is no problem.

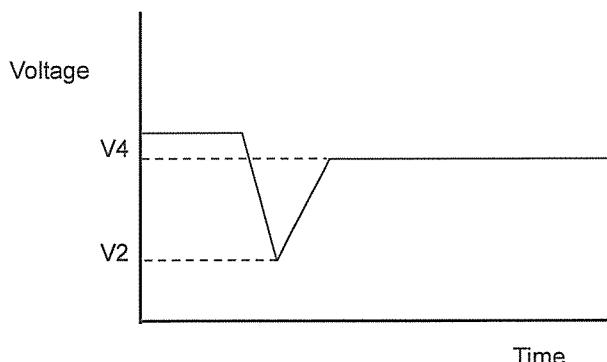


Fig 1

2. PARTS AND DRAWING LIST

Item	Q'ty/Compressor		Drawing No.	Remarks	Supply			
	DS1529S1	DS1836S1			Pat.1	Pat.2	Pat.3	Pat.4
Dimension sketch	X	-	NN0010271					-
	-	X	NN0010272					-
Circuit diagram	X	X	BB0041918					-
Refrigeration system	X	X	3CYCA6131					-
Connecting sketch of accumulator	X	X	3CYCA6121					-
Compressor packing sketch	Gathered Packing	X	BB0044458					-
	Individual Packing	X	BB0044459					-
OVER LOAD PROTECTOR	X	X	-	Internal OLP			YES	
Mounting Parts	RUBBER GROMMET	4	4	3CYC62866	3TMW65223A		YES	
	PIPE	4	4	4CYC11219	3PFHA5981A		YES	
	WASHER	4	4	4CYC11220	3SPAA5982A		YES	
Terminal and cover	HERM-COVER	1	1	BB0041336	BB0036762A		YES	
	RUBBER PLATE	1	1	3CYCA4999	3TKEA5983A		YES	
	NUT	1	1	3CYC62897	3SMGA5984A		YES	
	BUSH	1	1	BB0007021			YES	
Electrical parts	E-BOX	E	E	BB0000406	BB0000405E	YES	NO	
	START CAPACITOR	(1)	(1)	3CYCA4980	75µF/400V			
	RUNNING CAPACITOR	(1)	(1)	3CYCA4981	55µF/450V			
	DISCHARGE RESISTANCE	(1)	(1)	[note 8]	68kΩ/2W			
	STARTING RELAY [note 10]	(1)	(1)	NN0010273	AMVL-240V1			
	START CAPACITOR	1	1	3CYCA4980	75µF/400V	-	YES	
	RUNNING CAPACITOR	1	-	3CYCA4981	55µF/450V	-	YES	
	DISCHARGE RESISTANCE	1	1	[note 8]	68kΩ/2W	-	YES	
	STARTING RELAY [note 10]	1	1	NN0010273	AMVL-240V1	-	YES	
Cycle parts	CAPILLARY FOR REQUID INJECTION [note 9]	1	-	BB0032682B	Resistanc value 13.3kPa	YES		
		-	1	3CYCA4165	Resistanc value 2.67kPa			
	ACCUMULATOR	2	2	3CYCA5055	2PDP62110A valid volume 1060mL(530mL × 2)	YES	NO	

[note 8]

A discharge resistance has been attached to the starting capacitor.

[note 9]

The recommended resistance value for the injection capillary is the result of the matching trial using our calorimeter. Since proper capillary specification will depend on refrigeration cycle, please conduct a matching test installed in your product subject to the following conditions.

- (1) To satisfy the over load coil temperature: 115°C or lower. (preferably about 100°C max)
- (2) To apply the Injection capillary resistance value considering the appropriate amount of injection resulting in the best performance in the cooling capacity and input value.

[note 10]

You must REPLACE with RELAY of the follwing characteristics when usig flammable refrigerant.

Necessary characteristics

- Conforming to the ATEX directiv
- PICK-UP VOLTAGE (OPERATING VOLTAGE) : 130V TO 153V
- DROP-OUT VOLTAGE (RECOVERY VOLTAGE) : 90V MAX
- CONTACT RATING (CONTACT CAPACITY) : 20A BREAK 200,000 OPERATIONS

3. APPLICATION RANGE

1. Scope

This specification is applied to HITACHI scroll compressor.

2. Common specification of compressor

2.1 Appearance

The surface of compressor shall be painted black and has no cracks, dents, peeling, or significant rust.

2.2 Marking

Model name and production date should be shown on the surface of compressor. The compressor containing refrigeration oil and dried N₂ gas has one white circle mark and one yellow circle mark.

2.3 Insulation distances

IEC C60335-2-34 are applied.

2.4 Insulation resistance

Measurement should be above 10 MΩ between charged parts and non-charged parts by 500 V insulation resistance meter at normal temperature and normal humidity.

2.5 Dielectric Withstand Voltage Test

After 2.4 test, 1500 V A/C 50 Hz or 60 Hz is applied between live parts and dead metal parts continuously for one minute by gradual rise of voltage. In case of 1800 V, duration is one second instead of one minute.

2.6 Maximum allowable pressure and Test Pressure

Table 2. Test Pressure

Maximum allowable pressure				Tightness test pressure	Strength test pressure (type-test)
Refrigerant	R404A	R449A	R1270		
Pressure	3.19MPa[abs]	3.16MPa[abs]	2.28MPa[abs]	3.24MPa[abs]	15.79MPa[abs]

2.7 Dryness

Residual water content is below 0.18mL by the cold trap method described below:

Table 3. Cold trap method

Item	Condition
Furnace	146 ± 3 °C
Pre-heat hour	No pre-heat
Hour of taking water (Preheating time excluded)	6 hours
Degree of vacuum (Continuous vacuum)	Below 133 Pa[abs]
Solvent for cold bath	Methanol
Coolant for cold bath	Dry ice

2.8 Cleanliness

Drain the refrigerant oil. Pour washing liquid into the compressor. Lay down and roll the compressor and drain washing liquid. Filtrate by filter paper. The trapped particles should be under 70 mg.

2.9 Airtight test pressure

3.24 MPa[abs]

3. System design limitations [Requirement for using our compressor]

3.1 Complying with requirements of EN378

For safety use of our compressor with flammable refrigerant (R1270), assembler (or system manufacturer) should comply with EN378 series (European Standard).

EN378: Refrigerating systems and heat pumps- Safety and environmental requirements

EN378-1: Basic requirements, definitions, classification and selection criteria

EN378-2: Design, construction, testing, marking and documentation

EN378-3: Installation site and personal protection

EN378-4: Operation, maintenance, repair and recovery

3.2 Observance of the specification

The compressor should always be operated under the condition set forth in this specification and it should not be operated under any other specifications. Accessories should also be used as specified. In addition, the specified parts should be used during servicing. Fuse or circuit breaker should be connected to main electric circuit.

3.3 Power source voltage

Voltage applied to the hermetic terminal should be within the range mentioned in this specification.

In the case of 3 phases electric power source, the unequilibrium of the voltage between each phase must be used within 3%.

$$\text{Unequilibrium} = \frac{\text{Max.deviation voltage} - \text{Ave.voltage}}{\text{Average voltage}} \times 100(%)$$

Furthermore, in the case of 3 phases electric power source, the wiring for reverse rotating

caused by two phases replacement must not be used. The damage of the compressor caused by the reverse rotating is out of warranty. If wiring may cause reverse rotating, the direction relay listed on the list of equipment and materials must be connected.

3.4 Operating temperatures and pressures

Suction pressure and discharge pressure should be within the range of Fig.4~6 (Page 15~17)

The difference between discharge pressure and suction pressure must be more than the pressure of

Table 4. [Oil supply system in compressor doesn't work without this pressure difference.]

Table 4

Model	DS1529S1, DS1836S1
Discharge pressure – Suction pressure(MPa)	more than 0.61

The operating temperatures and pressures of a compressor should be within the range shown in the following section 3.4 - 3.8.

3.5 Compressor case bottom temp

6 degrees higher then condensing temperature. (Refer to Fig attached with 3.11.)

3.6 Motor winding temp. (Measured by the resistance method)

(1) Standard load condition

Rated voltage ; 105°C MAX

Rated voltage ±10% ; 115°C MAX

(2) Overload condition^[10]

Rated voltage ±7.5% ; 115°C MAX.

Winding temperature being lower than 115°C by liquid injection-cooling in any kind of environment.

[note 11] Overload condition should not be continuous.

3.7 Suction pipe temp.

Higher than outlet pipe of evaporator

3.8 Temperature and pressure at blocked fan condition

Don't operate compressor at blocked fan condition. To avoid problem of fire, discharge pressure should be under 4.22MPa^[abs]. Under stable condition, Confirm the motor winding temperature should be not more than 165°C (average) or 190°C MAX (highest).

3.9 Compressor ambient temperature

The compressor should be operated within the ambient temperature range that satisfies the motor winding temperature requirements shown previously Section 3.3. This compressor should be used in the place that the ambient temperature is above -10 °C. Please confirm the starting of compressor, when the temperature of compressor surface is -10 °C.

Under -10°C ambient temperature, in the case that the temperature of compressor surface is above -10°C by the crankcase beating etc, you can use the compressor if the starting is possible.

3.10 Operating and Shut-off interval

The compressor should not be started/stopped more than 6 times per hour. The compressor should be operated continuously at least for 5 minutes after being turned on. Allow a minimum of 3 minutes shut-off time before restarting.

Compressor should be started on the condition that pressure status of high/low pressure sides is balanced.

3.11 Oil back and oil level of compressor


Oil level of compressor should be higher than 10 mm from the lubricating piece fixed on the end of the crankshaft.

We recommend to check oil level using compressor with sight glass. We can supply the compressor with sight glass by your order. (In case of foaming situation, the height of this foam does not mean the height of the oil level.)

If the oil level is not kept, the oil shortage will occur, and influence the reliability of compressor.

To keep oil level, following points are important.

- 1) Oil should be returned continuously to the compressor.
- 2) The compressor should be operated continuously at least for 5 minutes after being turned on.
(see Clause 3.9)
- 3) Liquid refrigerant must not flood back to the compressor.
Oil may flow out of the compressor if liquid refrigerant back.
- 4) The pressure difference between discharge and suction is shown in Table 4. (see Clause 3.4)

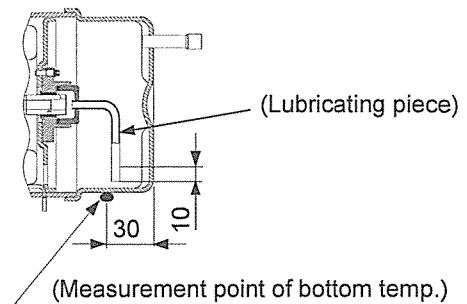

3.12 Liquid refrigerant back Accumulator

There should be superheated gas returned to the compressor under all normal operating conditions.

Liquid refrigerant must not flood back to the compressor.

Liquid back damages the compressor.

We recommend to use the accumulator to prevent liquid back to the compressor.

When knocking noise, current increase and undesirable vibration are caused,

another accumulator should be equipped to the compressor and/or

refrigerant charge should be reduced to prevent liquid refrigerant flood back.

Liquid level in the accumulator should be maintained smaller than the valid volume of accumulator. (see Fig 2)

We recommend to check liquid level in the accumulator using accumulator with sight glass.

We can supply the accumulator with sight glass by your order.

The accumulator must have a hole to return oil. If you use a non-specified accumulator, to prevent harm to oil return, please check size and location of oil return hole. Please refer to the drawing of accumulator.

3.13 Strainer

Strainer should be equipped to avoid insert foreign bodies.

We can supply the accumulator with a strainer by your order.

In case of using an accumulator without a strainer, a strainer should be added to a tube on suction side.

3.14 Allowable incline

Compressor should be operating in the horizontal rotating shaft. But the inclination of shaft is within 3 deg in every direction. In case of the hermetic terminal side in the shaft direction is higher than horizontal, it should be kept up to 5 deg.

3.15 Pipe vibration

The displacement of the pipes, which connect from the compressor to other parts of the refrigeration systems, should be less than 0.8 mm (1/32") when the compressor is operating at rated frequency +10 / -10 and voltage range of rate $\pm 10\%$.

Displacement in excess of 0.8 mm (1/32") will require changing tube length and/or routing.

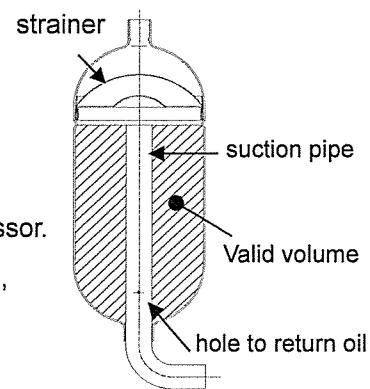


Fig 2

3.16 Connecting tube design

in designing and routing tubing that connects the compressor to the other parts of the air conditioner, the following should be considered.

Moving tubes to the moving parts;

minimum clearance 12.7 mm (1/2")

Moving tubes to non-moving parts ;

minimum clearance 9.5 mm (3/8")

Moving tubes never touch the electrical lead wires.

3.17 Dust of hermetic terminal

Hermetic terminal area should be covered with the electrical cover by the designated method to prevent the entering of dust.

3.18 Rotation direction of compressor

Connect compressor terminals as specified in circuit diagram. Reverse operation will result pump breakdown.

3.19 Internal over load protector (OLP).

Although an OLP that Hitachi selected is installed in this compressor, the current and temperature may not be appropriated for the structure or design of the unit in which the compressor will be mounted.

Unit-mounting matching tests should therefore be conducted and checks should be performed to ensure that the requirements listed as item (1) and (2) below are satisfied.

If the OLP could not satisfy the requirements in the unit test, this should be notified to Hitachi and then after reselection through mutual discussions on the optimum OLP for the unit, unit-mounting test should be performed again.

(1) OLP non-operating test:

The provisions of section 3.3 should be satisfied.

(2) OLP operating test (trouble-assuming test):

When the compressor ambient temperature is 23 ± 2 °C, the winding temperature should not exceed 190 °C at rated voltage $\pm 6\%$, and when the compressor ambient temperature is 0 ± 2 °C, the winding temperature should not exceed 240 °C at rated voltage -15%.

Supplementary description;

[1] Exception for the value in transitional states.

[2] The motor winding temperature should be

measured using the resistance method.

[3] The tests should be terminated when the total number of OLP operations or the total OLP operating time reaches 10,000 (time) or 15 days, which ever comes first.

But OLP is equipped in order to avoid the problem of fire.

It's not for a restriction of coil temperature, 115°C MAX.

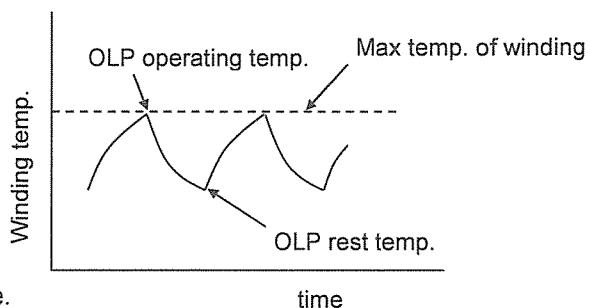


Fig 3

4. Process limitations

- 4.1 The degree of vacuum in the refrigerating system should be less than 133 Pa 「abs」 at room temperature just before charging refrigerant.
The reference quantity of water in the refrigerating system is less than 0.2g.
The quantity of water the cycle in operation is to make to the 40 ppm following in the refrigerating cycle by using the suitable dryer that does not contain ACTIVATED ALUMINA.
- 4.2 The structure of cycle constitution or drier should be done so that the powder of the drying material does not come out throughout the cycle.
- 4.3 The weight of foreign particles on the inside surface of the heat exchange tubes should be less than 0.05 g/m². This value means the weight of foreign particles filtered after washing inside surface of the heat exchange tubes with alkali.
Metallic dust should not be permitted to enter the refrigerating system.
- 4.4 Eliminate all system contaminates such as trichloroethane, alkalis, soaps, acids, oil and washing fluid used in machining the heat exchanger.
- 4.5 Always purge the compressor with dry nitrogen during assembly of the system.
- 4.6 The quantity and kind of contamination (the process materials) in the cycle should be grasped and managed. Carry on reliability test that Input contamination a lot than anticipated contamination quantity.
- 4.7 The motor winding temperatures should be less than 149 °C in process of manufacturing the refrigerating system. The temperature of the hermetic terminal body should be less than 177 °C.
- 4.8 The compressor should be operated for more than 20 seconds within 15 minutes after refrigerant is put into the system so that proper lubrication of the pump can occur.

5. Miscellaneous

- 5.1 The pipe and hermetic pins, which are attached to the compressor, should not be bent.
- 5.2 The compressor should never be operated while under vacuum; otherwise, internal arcing can damage parts.
- 5.3 The compressor should not be operated in a method that forms a vacuum and absorbs air.
- 5.4 The compressor should not be left open to the atmosphere for more than 15 minutes.
- 5.5 The electric pulse should not be applied to the hermetic terminals when the compressor is under vacuum.
- 5.6 The compressor should be kept in a clean place with low-moisture.
- 5.7 The compressor must not be applied for transportation equipment such as automobiles, trains, ships, and the others.
- 5.8 The compressor should not be splashed intentionally with water.
- 5.9 Refrigerant should be charged from the condenser end of the refrigeration system. Never charge refrigerant to the compressor directly.
- 5.10 Temperatures within systems during stable compressor operation should not be less than -45 °C because oil is hard to return to the compressor.
- 5.11 The compressor, if dropped, should not be used.

5.12 Compressor mounting

Rubber grommets are designed soft to provide noise isolation and to lessen vibration energy transmission. Stud bolt should be designed to provide sufficient clearance for noise and vibration isolation and to prevent compressor from coming off its mount.

5.13 The first starting voltage supplied to the refrigerating system should be more than the starting voltage mentioned Table 1. (Page 4)

Because the viscosity of the oil may be high at first starting until the refrigerant dissolves in the oil.

5.14 The compressor should be kept out of a corrosive atmosphere, such as a chemicals storage area.

5.15 The lead wires should be connected to the hermetic terminals without touching the surface of the compressor.

5.16 The compressor should be used within one year of receipt.

5.17 The failure of refrigeration system components such as the reversing valve, solenoid valve, defrost mechanism, refrigerant control parts, fan motor, etc. may cause failure of the compressor. Reliability of those components should be checked.

A design that insures no leakage during manufacturing and usage should be applied.

5.18 The refrigerating cycle should be grounded.

5.19 The failure of accessory parts (ex. Capacitor) utilized by the customer is not related to Hitachi-Johnson Controls Air Conditioning, Inc.

5.20 The person who is directly in charge of setting up the product or repair of the product should be well instructed to prevent contamination of this product by water or other foreign matters.

When recharging refrigerator, dryer must be changed. And water value should be less than 40 ppm.

5.21 When connecting terminals of the unit to the hermetically sealed terminals of the compressor, the parts must not be obliquely connected or twisted after connection, fastening force of the terminals would be reduced.

5.22 Modifications and additions

If modifications or additions are to be made to the items provided for in this specification, both companies shall immediately report the details of those modifications or additions, together with the reasons for them, in writing before performing the modifications or additions.

5.23 Occurrence of problems

If problems occur after delivery, both companies shall immediately list those problems. After reporting, a solution to these problems will be sought and reported.

Hitachi-Johnson Controls Air Conditioning, Inc. has no obligation duty for the problem in the case that the user didn't obey this compressor using specification & criteria.

5.24 Term of Validity

This specification shall go into effect from the date that the user signs the specification.

5.25 Submission of this Specification


Hitachi-Johnson Controls Air Conditioning, Inc. will submit two copies of this specification and the user shall return one copy only after acknowledging receipt of the specification.

This specification will be kept in the compressors Design of Hitachi-Johnson Controls Air Conditioning, Inc.

4. RANGE OF USABLE PRESSURE

Model : DS1529S1,DS1836S1

REFRIGERANT : R404A

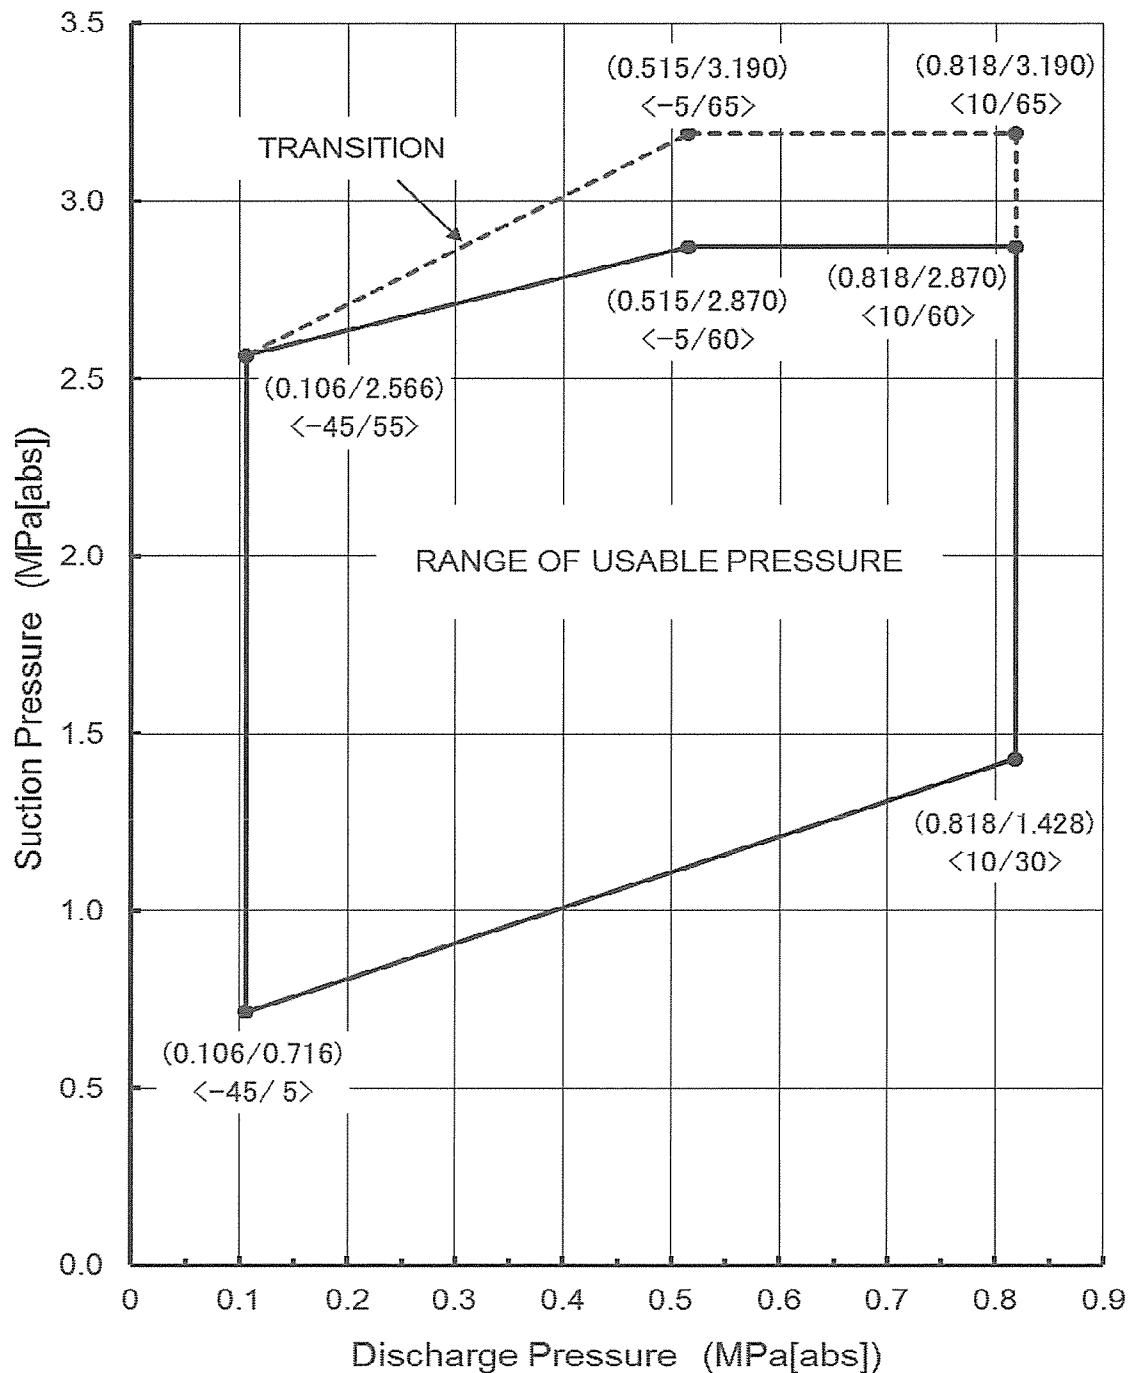


(Suction pressure / Discharge pressure (MPa[abs]))

< Evaporation Temp (dew point) / Condensing Temp (dew point) [°C] >

Fig 4

Model : DS1529S1,DS1836S1

REFRIGERANT : R449A

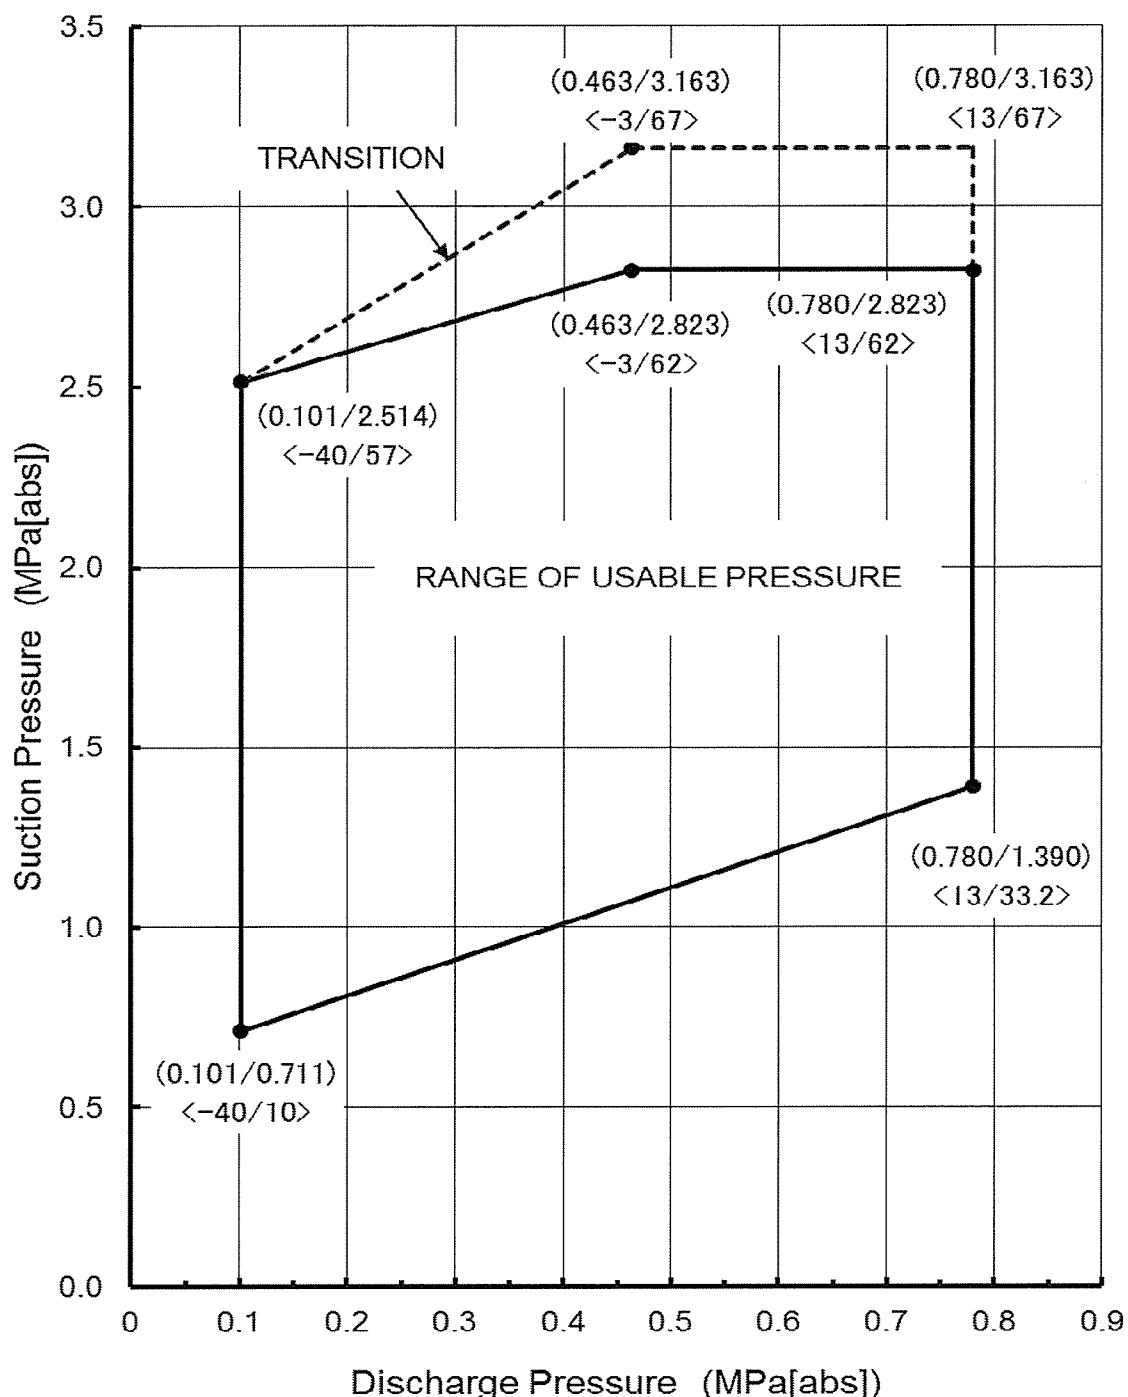


(Suction pressure / Discharge pressure (MPa[abs]))

< Evaporation Temp (dew point) / Condensing Temp (dew point) [°C] >

Fig 5

Model : DS1529S1,DS1836S1

REFRIGERANT : R1270A

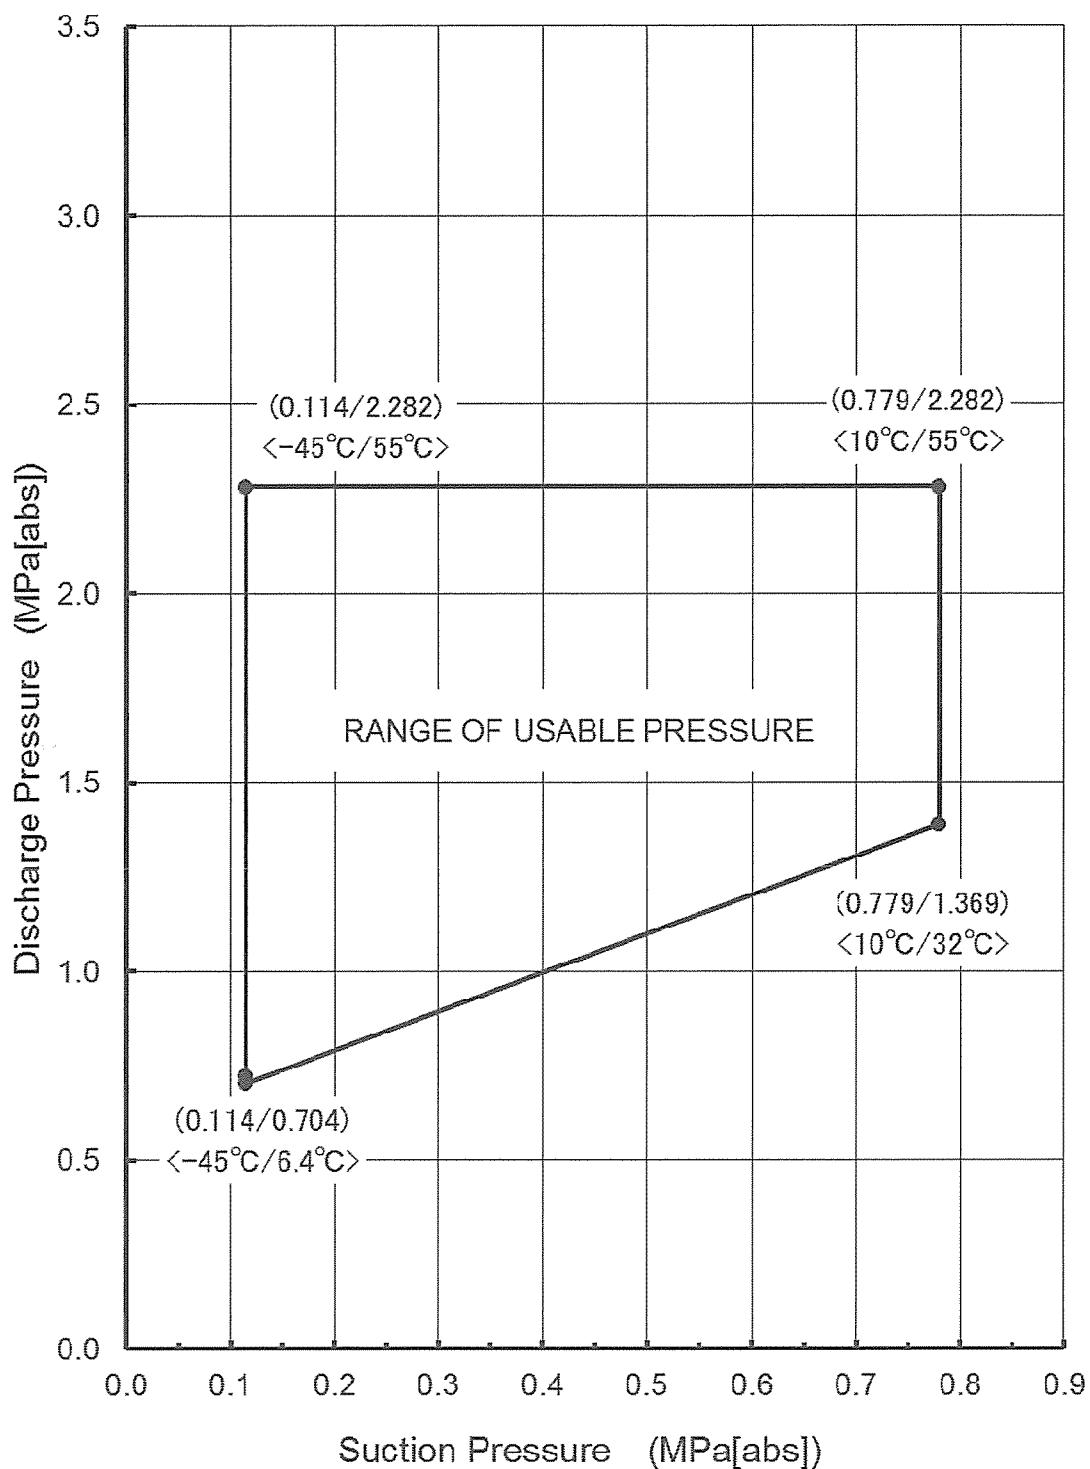

(Suction pressure / Discharge pressure (MPa[abs]))

< Evaporation Temp (dew point) / Condensing Temp (dew point) [°C] >

Fig 6

5. PERFORMANCE DATA**Model : DS1529S1 REFRIGERANT : R404A**

Refrigerant	R404A
Power Supply	1PH/220-240V/50Hz
Sub Cooling	0 K
Return Gas Temp.	18 °C
Cooling	Fan Cooling+Liquid Injection

Cooling capacity[W]

Calculated values

Condensing Temp. °C	Power Supply	Evaporating Temp. °C											
		-45	-40	-35	-30	-25	-20	-15	-10	-5	0	5	10
35	220V-50Hz	780	970	1,222	1,536	1,912	2,351	2,852	3,415	4,040	4,728	5,478	6,290
	240V-50Hz	782	972	1,225	1,540	1,918	2,358	2,860	3,425	4,052	4,742	5,494	6,308
40	220V-50Hz	725	898	1,131	1,421	1,771	2,178	2,644	3,169	3,752	4,394	5,094	5,853
	240V-50Hz	727	901	1,134	1,426	1,776	2,185	2,652	3,178	3,763	4,407	5,109	5,870
45	220V-50Hz	670	827	1,040	1,307	1,629	2,006	2,437	2,923	3,464	4,060	4,711	5,416
	240V-50Hz	672	830	1,043	1,311	1,634	2,011	2,444	2,932	3,474	4,072	4,724	5,432
50	220V-50Hz	601	751	950	1,196	1,490	1,832	2,222	2,660	3,146	3,680	4,263	4,893
	240V-50Hz	603	754	952	1,199	1,494	1,837	2,229	2,668	3,155	3,691	4,275	4,907
55	220V-50Hz	533	676	859	1,084	1,351	1,658	2,007	2,397	2,828	3,301	3,815	4,369
	240V-50Hz	534	677	862	1,088	1,355	1,663	2,013	2,404	2,837	3,310	3,826	4,382

Motor Input[W]

Calculated values

Condensing Temp. °C	Power Supply	Evaporating Temp. °C											
		-45	-40	-35	-30	-25	-20	-15	-10	-5	0	5	10
35	220V-50Hz	1,026	1,056	1,086	1,117	1,147	1,177	1,207	1,237	1,267	1,297	1,327	1,357
	240V-50Hz	1,075	1,106	1,138	1,169	1,201	1,232	1,264	1,295	1,327	1,358	1,390	1,421
40	220V-50Hz	1,126	1,157	1,188	1,219	1,250	1,281	1,312	1,342	1,373	1,404	1,435	1,466
	240V-50Hz	1,179	1,211	1,244	1,276	1,309	1,341	1,373	1,406	1,438	1,471	1,503	1,535
45	220V-50Hz	1,226	1,257	1,289	1,321	1,353	1,385	1,416	1,448	1,480	1,512	1,543	1,575
	240V-50Hz	1,283	1,317	1,350	1,383	1,416	1,450	1,483	1,516	1,550	1,583	1,616	1,649
50	220V-50Hz	1,372	1,293	1,293	1,293	1,293	1,293	1,293	1,293	1,293	1,293	1,293	1,293
	240V-50Hz	1,437	1,470	1,503	1,536	1,569	1,602	1,635	1,668	1,701	1,734	1,767	1,799
55	220V-50Hz	1,519	1,550	1,581	1,613	1,644	1,675	1,706	1,737	1,768	1,800	1,831	1,862
	240V-50Hz	1,591	1,623	1,656	1,689	1,721	1,754	1,786	1,819	1,852	1,884	1,917	1,950

Current[A]

Calculated values

Condensing Temp. °C	Power Supply	Evaporating Temp. °C											
		-45	-40	-35	-30	-25	-20	-15	-10	-5	0	5	10
35	220V-50Hz	4.8	4.9	5.0	5.2	5.3	5.5	5.6	5.7	5.9	6.0	6.2	6.3
	240V-50Hz	4.6	4.7	4.8	5.0	5.1	5.2	5.4	5.5	5.6	5.8	5.9	6.0
40	220V-50Hz	5.2	5.3	5.5	5.6	5.8	5.9	6.0	6.2	6.3	6.5	6.6	6.7
	240V-50Hz	5.0	5.1	5.3	5.4	5.5	5.7	5.8	5.9	6.1	6.2	6.3	6.5
45	220V-50Hz	5.7	5.8	5.9	6.1	6.2	6.3	6.5	6.6	6.8	6.9	7.0	7.2
	240V-50Hz	5.4	5.6	5.7	5.8	6.0	6.1	6.2	6.4	6.5	6.6	6.8	6.9
50	220V-50Hz	6.3	6.5	6.6	6.7	6.9	7.0	7.1	7.3	7.4	7.6	7.7	7.8
	240V-50Hz	6.1	6.2	6.3	6.5	6.6	6.7	6.9	7.0	7.1	7.3	7.4	7.5
55	220V-50Hz	7.0	7.1	7.3	7.4	7.5	7.7	7.8	8.0	8.1	8.2	8.4	8.5
	240V-50Hz	6.7	6.8	7.0	7.1	7.2	7.4	7.5	7.6	7.8	7.9	8.0	8.2

Model : DS1529S1

REFRIGERANT : R449A

Refrigerant	R449A
Power Supply	1PH/220-240V/50Hz
Sub Cooling	0 K
Return Gas Temp.	18 °C
Cooling	Fan Cooling+Liquid Injection

Cooling capacity[W]

Calculated values

Condensing Temp. °C	Power Supply	Evaporating Temp. °C											
		-45	-40	-35	-30	-25	-20	-15	-10	-5	0	5	10
35	220V-50Hz	670	847	1,083	1,382	1,744	2,172	2,666	3,229	3,860	4,562	5,333	6,174
	240V-50Hz	672	849	1,086	1,386	1,749	2,178	2,673	3,237	3,871	4,574	5,347	6,190
40	220V-50Hz	631	795	1,016	1,296	1,637	2,040	2,507	3,040	3,638	4,304	5,037	5,837
	240V-50Hz	633	797	1,019	1,300	1,641	2,046	2,514	3,047	3,647	4,314	5,049	5,852
45	220V-50Hz	592	744	950	1,211	1,531	1,910	2,350	2,852	3,418	4,048	4,744	5,505
	240V-50Hz	594	746	952	1,214	1,535	1,915	2,355	2,859	3,426	4,058	4,755	5,519
50	220V-50Hz	542	689	884	1,130	1,427	1,779	2,185	2,648	3,168	3,748	4,387	5,088
	240V-50Hz	544	691	886	1,133	1,432	1,784	2,192	2,656	3,178	3,760	4,401	5,104
55	220V-50Hz	492	635	820	1,051	1,328	1,653	2,027	2,452	2,928	3,458	4,043	4,685
	240V-50Hz	493	636	822	1,053	1,331	1,657	2,032	2,458	2,936	3,468	4,054	4,698

Motor Input[W]

Calculated values

Condensing Temp. °C	Power Supply	Evaporating Temp. °C											
		-45	-40	-35	-30	-25	-20	-15	-10	-5	0	5	10
35	220V-50Hz	949	976	1,003	1,031	1,060	1,089	1,119	1,151	1,185	1,220	1,258	1,300
	240V-50Hz	1,005	1,034	1,063	1,092	1,121	1,151	1,183	1,215	1,249	1,285	1,323	1,365
40	220V-50Hz	1,043	1,071	1,099	1,128	1,157	1,187	1,219	1,251	1,286	1,322	1,362	1,405
	240V-50Hz	1,104	1,133	1,162	1,192	1,222	1,253	1,284	1,318	1,353	1,390	1,430	1,474
45	220V-50Hz	1,139	1,167	1,196	1,225	1,255	1,286	1,318	1,352	1,388	1,425	1,466	1,511
	240V-50Hz	1,202	1,232	1,261	1,291	1,322	1,354	1,387	1,422	1,458	1,497	1,539	1,585
50	220V-50Hz	1,277	1,205	1,205	1,206	1,207	1,209	1,212	1,216	1,221	1,228	1,236	1,247
	240V-50Hz	1,344	1,373	1,403	1,433	1,464	1,496	1,529	1,564	1,601	1,641	1,684	1,731
55	220V-50Hz	1,416	1,444	1,472	1,501	1,531	1,561	1,594	1,627	1,663	1,702	1,744	1,789
	240V-50Hz	1,488	1,517	1,546	1,577	1,608	1,641	1,675	1,710	1,748	1,789	1,832	1,880

Current[A]

Calculated values

Condensing Temp. °C	Power Supply	Evaporating Temp. °C											
		-45	-40	-35	-30	-25	-20	-15	-10	-5	0	5	10
35	220V-50Hz	4.5	4.6	4.7	4.9	5.0	5.1	5.3	5.4	5.5	5.7	5.9	6.1
	240V-50Hz	4.3	4.4	4.5	4.7	4.8	4.9	5.0	5.2	5.3	5.5	5.6	5.8
40	220V-50Hz	4.9	5.0	5.1	5.3	5.4	5.5	5.7	5.8	6.0	6.1	6.3	6.5
	240V-50Hz	4.7	4.8	4.9	5.1	5.2	5.3	5.4	5.6	5.7	5.9	6.0	6.2
45	220V-50Hz	5.3	5.4	5.6	5.7	5.8	5.9	6.1	6.2	6.4	6.5	6.7	6.9
	240V-50Hz	5.1	5.2	5.3	5.5	5.6	5.7	5.8	6.0	6.1	6.3	6.5	6.6
50	220V-50Hz	5.9	6.1	6.2	6.3	6.5	6.6	6.8	6.9	7.1	7.2	7.4	7.6
	240V-50Hz	5.7	5.8	5.9	6.1	6.2	6.3	6.5	6.6	6.7	6.9	7.1	7.3
55	220V-50Hz	6.5	6.7	6.8	6.9	7.1	7.2	7.3	7.5	7.7	7.8	8.0	8.2
	240V-50Hz	6.3	6.4	6.5	6.7	6.8	6.9	7.1	7.2	7.4	7.5	7.7	7.9

Model : DS1529S1**REFRIGERANT : R1270**

Refrigerant	R1270
Power Supply	1PH/220-240V/50Hz
Sub Cooling	0 K
Return Gas Temp.	18 °C
Cooling	Fan Cooling+Liquid Injection

Cooling capacity[W]

Calculated values

Condensing Temp. °C	Power Supply	Evaporating Temp. °C											
		-45	-40	-35	-30	-25	-20	-15	-10	-5	0		
35	220V-50Hz	845	1,032	1,279	1,583	1,943	2,357	2,823	3,339	3,905	4,518	5,177	5,879
	240V-50Hz	847	1,035	1,282	1,588	1,949	2,364	2,831	3,349	3,916	4,531	5,192	5,896
40	220V-50Hz	800	974	1,206	1,493	1,833	2,225	2,668	3,160	3,700	4,286	4,917	5,592
	240V-50Hz	802	977	1,209	1,497	1,839	2,232	2,676	3,169	3,710	4,298	4,931	5,608
45	220V-50Hz	752	913	1,129	1,398	1,718	2,088	2,506	2,971	3,483	4,040	4,642	5,287
	240V-50Hz	755	916	1,132	1,402	1,723	2,094	2,513	2,980	3,493	4,052	4,655	5,302
50	220V-50Hz	694	853	1,060	1,315	1,617	1,963	2,353	2,786	3,262	3,779	4,339	4,941
	240V-50Hz	696	855	1,063	1,319	1,621	1,968	2,360	2,794	3,271	3,790	4,352	4,955
55	220V-50Hz	632	787	986	1,226	1,507	1,827	2,187	2,584	3,020	3,494	4,007	4,560
	240V-50Hz	634	790	989	1,230	1,511	1,833	2,193	2,592	3,029	3,505	4,019	4,573

Motor Input[W]

Calculated values

Condensing Temp. °C	Power Supply	Evaporating Temp. °C											
		-45	-40	-35	-30	-25	-20	-15	-10	-5	0		
35	220V-50Hz	1,096	1,108	1,121	1,134	1,147	1,161	1,175	1,190	1,204	1,218	1,233	1,246
	240V-50Hz	1,147	1,160	1,173	1,187	1,201	1,216	1,231	1,246	1,261	1,276	1,291	1,305
40	220V-50Hz	1,204	1,216	1,228	1,240	1,254	1,267	1,281	1,295	1,310	1,324	1,338	1,353
	240V-50Hz	1,261	1,273	1,286	1,299	1,313	1,327	1,341	1,356	1,371	1,386	1,401	1,416
45	220V-50Hz	1,313	1,324	1,335	1,347	1,360	1,374	1,387	1,401	1,416	1,430	1,445	1,459
	240V-50Hz	1,375	1,386	1,398	1,411	1,424	1,438	1,453	1,467	1,482	1,497	1,513	1,528
50	220V-50Hz	1,473	1,364	1,342	1,321	1,303	1,285	1,269	1,254	1,240	1,227	1,215	1,203
	240V-50Hz	1,543	1,551	1,560	1,570	1,581	1,593	1,605	1,618	1,632	1,646	1,660	1,674
55	220V-50Hz	1,634	1,638	1,644	1,652	1,660	1,669	1,680	1,690	1,702	1,714	1,726	1,739
	240V-50Hz	1,711	1,716	1,722	1,730	1,738	1,748	1,759	1,770	1,782	1,794	1,808	1,821

Current[A]

Calculated values

Condensing Temp. °C	Power Supply	Evaporating Temp. °C											
		-45	-40	-35	-30	-25	-20	-15	-10	-5	0		
35	220V-50Hz	5.3	5.4	5.4	5.5	5.5	5.6	5.7	5.7	5.8	5.9	5.9	6.0
	240V-50Hz	4.9	4.9	5.0	5.0	5.1	5.1	5.2	5.3	5.3	5.4	5.5	5.5
40	220V-50Hz	5.8	5.8	5.9	6.0	6.0	6.1	6.1	6.2	6.3	6.3	6.4	6.4
	240V-50Hz	5.3	5.4	5.4	5.5	5.5	5.6	5.7	5.7	5.8	5.8	5.9	6.0
45	220V-50Hz	6.3	6.3	6.4	6.4	6.5	6.5	6.6	6.7	6.7	6.8	6.9	6.9
	240V-50Hz	5.8	5.8	5.9	5.9	6.0	6.1	6.1	6.2	6.2	6.3	6.4	6.4
50	220V-50Hz	7.0	6.5	6.4	6.3	6.2	6.2	6.1	6.0	6.0	5.9	5.8	5.8
	240V-50Hz	6.5	6.5	6.6	6.6	6.6	6.7	6.7	6.8	6.9	6.9	7.0	7.0
55	220V-50Hz	7.7	7.7	7.7	7.8	7.8	7.8	7.9	7.9	8.0	8.0	8.1	8.1
	240V-50Hz	7.2	7.2	7.2	7.3	7.3	7.3	7.4	7.4	7.5	7.5	7.6	7.6

Model : DS1836S1

REFRIGERANT : R404A

Refrigerant	R404A
Power Supply	1PH/220-240V/50Hz
Sub Cooling	0 K
Return Gas Temp.	18 °C
Cooling	Fan Cooling+Liquid Injection

Cooling capacity[W]

Calculated values

Condensing Temp. °C	Power Supply	Evaporating Temp. °C											
		-45	-40	-35	-30	-25	-20	-15	-10	-5	0	5	10
35	220V-50Hz	1,079	1,240	1,499	1,855	2,309	2,861	3,510	4,256	5,100	6,041	7,080	8,217
	240V-50Hz	1,092	1,245	1,498	1,850	2,302	2,854	3,506	4,258	5,109	6,060	7,111	8,262
40	220V-50Hz	982	1,131	1,369	1,697	2,113	2,619	3,214	3,897	4,670	5,532	6,483	7,523
	240V-50Hz	991	1,135	1,370	1,696	2,112	2,619	3,216	3,905	4,684	5,553	6,514	7,565
45	220V-50Hz	884	1,022	1,240	1,538	1,917	2,377	2,918	3,539	4,240	5,022	5,885	6,829
	240V-50Hz	889	1,025	1,242	1,541	1,921	2,383	2,927	3,552	4,258	5,047	5,916	6,868
50	220V-50Hz	787	912	1,110	1,380	1,721	2,135	2,622	3,180	3,810	4,513	5,288	6,134
	240V-50Hz	788	915	1,115	1,386	1,731	2,148	2,637	3,199	3,833	4,540	5,319	6,170
55	220V-50Hz	689	803	980	1,221	1,525	1,894	2,326	2,821	3,380	4,003	4,690	5,440
	240V-50Hz	687	805	987	1,232	1,540	1,912	2,347	2,846	3,408	4,033	4,721	5,473

Motor Input[W]

Calculated values

Condensing Temp. °C	Power Supply	Evaporating Temp. °C											
		-45	-40	-35	-30	-25	-20	-15	-10	-5	0	5	10
35	220V-50Hz	1,538	1,528	1,518	1,508	1,498	1,489	1,479	1,469	1,459	1,449	1,439	1,430
	240V-50Hz	1,609	1,600	1,590	1,581	1,572	1,562	1,553	1,544	1,534	1,525	1,516	1,506
40	220V-50Hz	1,711	1,705	1,699	1,693	1,687	1,681	1,676	1,670	1,664	1,658	1,652	1,646
	240V-50Hz	1,810	1,803	1,796	1,789	1,782	1,775	1,768	1,761	1,754	1,747	1,740	1,733
45	220V-50Hz	1,884	1,882	1,880	1,878	1,876	1,874	1,873	1,871	1,869	1,867	1,865	1,863
	240V-50Hz	2,011	2,006	2,002	1,997	1,992	1,988	1,983	1,978	1,974	1,969	1,965	1,960
50	220V-50Hz	2,057	2,059	2,061	2,063	2,065	2,067	2,069	2,072	2,074	2,076	2,078	2,080
	240V-50Hz	2,212	2,210	2,207	2,205	2,203	2,200	2,198	2,196	2,194	2,191	2,189	2,187
55	220V-50Hz	2,230	2,236	2,242	2,248	2,254	2,260	2,266	2,272	2,279	2,285	2,291	2,297
	240V-50Hz	2,413	2,413	2,413	2,413	2,413	2,413	2,413	2,413	2,414	2,414	2,414	2,414

Current[A]

Calculated values

Condensing Temp. °C	Power Supply	Evaporating Temp. °C											
		-45	-40	-35	-30	-25	-20	-15	-10	-5	0	5	10
35	220V-50Hz	7.5	7.5	7.5	7.5	7.5	7.5	7.5	7.5	7.5	7.5	7.5	7.5
	240V-50Hz	7.5	7.5	7.5	7.5	7.5	7.5	7.5	7.5	7.5	7.5	7.5	7.5
40	220V-50Hz	8.0	8.0	8.0	8.0	8.0	8.0	8.0	8.0	8.0	8.1	8.1	8.1
	240V-50Hz	8.0	8.0	8.0	8.0	8.0	8.0	8.1	8.1	8.1	8.1	8.1	8.1
45	220V-50Hz	8.5	8.5	8.5	8.6	8.6	8.6	8.6	8.6	8.6	8.6	8.6	8.6
	240V-50Hz	8.5	8.6	8.6	8.6	8.6	8.6	8.6	8.6	8.6	8.6	8.6	8.7
50	220V-50Hz	9.0	9.1	9.1	9.1	9.1	9.1	9.1	9.2	9.2	9.2	9.2	9.2
	240V-50Hz	9.1	9.1	9.1	9.1	9.1	9.1	9.2	9.2	9.2	9.2	9.2	9.2
55	220V-50Hz	9.6	9.6	9.6	9.6	9.6	9.7	9.7	9.7	9.7	9.8	9.8	9.8
	240V-50Hz	9.6	9.6	9.6	9.6	9.7	9.7	9.7	9.7	9.8	9.8	9.8	9.8

Model : DS1836S1**REFRIGERANT : R449A**

Refrigerant	R449A
Power Supply	1PH/220-240V/50Hz
Sub Cooling	0 K
Return Gas Temp.	18 °C
Cooling	Fan Cooling+Liquid Injection

Cooling capacity[W]

Calculated values

Condensing Temp. °C	Power Supply	Evaporating Temp. °C										
		-45	-40	-35	-30	-25	-20	-15	-10	-5	0	
35	220V-50Hz	928	1,084	1,331	1,671	2,107	2,644	3,282	4,024	4,872	5,828	6,892
	240V-50Hz	940	1,089	1,330	1,667	2,103	2,640	3,281	4,029	4,885	5,851	6,927
40	220V-50Hz	856	1,003	1,233	1,550	1,957	2,456	3,050	3,742	4,532	5,422	6,413
	240V-50Hz	864	1,006	1,234	1,549	1,956	2,456	3,053	3,749	4,545	5,443	6,444
45	220V-50Hz	784	921	1,135	1,428	1,805	2,268	2,818	3,457	4,189	5,013	5,933
	240V-50Hz	788	924	1,137	1,431	1,809	2,273	2,826	3,470	4,206	5,037	5,963
50	220V-50Hz	711	838	1,036	1,307	1,653	2,079	2,584	3,173	3,846	4,605	5,453
	240V-50Hz	712	841	1,040	1,313	1,662	2,090	2,599	3,191	3,868	4,632	5,485
55	220V-50Hz	638	756	937	1,186	1,503	1,891	2,353	2,891	3,506	4,201	4,979
	240V-50Hz	636	758	944	1,196	1,517	1,910	2,375	2,916	3,534	4,232	5,012

Motor Input[W]

Calculated values

Condensing Temp. °C	Power Supply	Evaporating Temp. °C										
		-45	-40	-35	-30	-25	-20	-15	-10	-5	0	
35	220V-50Hz	1,419	1,411	1,405	1,398	1,392	1,387	1,382	1,377	1,374	1,371	1,370
	240V-50Hz	1,473	1,466	1,458	1,452	1,446	1,440	1,436	1,432	1,429	1,428	1,431
40	220V-50Hz	1,570	1,566	1,563	1,560	1,557	1,555	1,554	1,554	1,554	1,557	1,561
	240V-50Hz	1,664	1,658	1,654	1,649	1,646	1,643	1,640	1,639	1,639	1,641	1,644
45	220V-50Hz	1,730	1,730	1,729	1,730	1,731	1,733	1,735	1,739	1,744	1,751	1,760
	240V-50Hz	1,854	1,851	1,849	1,847	1,845	1,844	1,845	1,846	1,848	1,853	1,869
50	220V-50Hz	1,896	1,899	1,902	1,906	1,911	1,917	1,923	1,931	1,940	1,951	1,964
	240V-50Hz	2,047	2,046	2,045	2,045	2,046	2,048	2,050	2,054	2,059	2,066	2,075
55	220V-50Hz	2,065	2,071	2,078	2,086	2,094	2,104	2,114	2,126	2,139	2,154	2,171
	240V-50Hz	2,241	2,242	2,244	2,246	2,249	2,253	2,258	2,264	2,272	2,281	2,293

Current[A]

Calculated values

Condensing Temp. °C	Power Supply	Evaporating Temp. °C										
		-45	-40	-35	-30	-25	-20	-15	-10	-5	0	
35	220V-50Hz	6.8	6.9	6.9	6.9	6.9	6.9	6.9	6.9	7.0	7.0	7.1
	240V-50Hz	6.8	6.7	6.7	6.7	6.7	6.8	6.8	6.8	6.8	6.9	7.0
40	220V-50Hz	7.4	7.4	7.4	7.4	7.4	7.4	7.5	7.5	7.5	7.6	7.7
	240V-50Hz	7.4	7.4	7.4	7.4	7.5	7.5	7.5	7.5	7.6	7.6	7.7
45	220V-50Hz	7.9	7.9	7.9	7.9	7.9	8.0	8.0	8.0	8.1	8.1	8.2
	240V-50Hz	7.9	7.9	8.0	8.0	8.0	8.0	8.0	8.1	8.1	8.2	8.3
50	220V-50Hz	8.4	8.4	8.4	8.4	8.5	8.5	8.5	8.6	8.6	8.7	8.8
	240V-50Hz	8.4	8.4	8.4	8.4	8.5	8.5	8.5	8.6	8.6	8.7	8.8
55	220V-50Hz	8.9	8.9	8.9	8.9	9.0	9.0	9.0	9.1	9.1	9.2	9.3
	240V-50Hz	8.8	8.9	8.9	8.9	8.9	9.0	9.0	9.1	9.1	9.2	9.3

Model : DS1836S1

REFRIGERANT : R1270

Refrigerant	R1270
Power Supply	1PH/220-240V/50Hz
Sub Cooling	0 K
Return Gas Temp.	18 °C
Cooling	Fan Cooling+Liquid Injection

Cooling capacity[W]

Calculated values

Condensing Temp. °C	Power Supply	Evaporating Temp. °C										
		-45	-40	-35	-30	-25	-20	-15	-10	-5	0	
35	220V-50Hz	1,150	1,299	1,544	1,882	2,309	2,822	3,419	4,096	4,851	5,682	6,585
	240V-50Hz	1,164	1,304	1,543	1,877	2,303	2,816	3,415	4,097	4,859	5,699	6,614
40	220V-50Hz	1,066	1,206	1,437	1,754	2,153	2,633	3,191	3,824	4,531	5,310	6,158
	240V-50Hz	1,076	1,211	1,438	1,752	2,152	2,633	3,194	3,832	4,545	5,331	6,188
45	220V-50Hz	977	1,109	1,324	1,619	1,990	2,435	2,952	3,540	4,195	4,919	5,707
	240V-50Hz	983	1,113	1,327	1,622	1,994	2,441	2,961	3,553	4,213	4,942	5,737
50	220V-50Hz	894	1,019	1,219	1,494	1,838	2,252	2,732	3,277	3,887	4,561	5,297
	240V-50Hz	895	1,022	1,225	1,501	1,848	2,264	2,748	3,297	3,910	4,588	5,328
55	220V-50Hz	805	921	1,107	1,359	1,675	2,054	2,493	2,993	3,553	4,171	4,849
	240V-50Hz	801	924	1,114	1,371	1,691	2,073	2,517	3,019	3,581	4,202	4,881

Motor Input[W]

Calculated values

Condensing Temp. °C	Power Supply	Evaporating Temp. °C										
		-45	-40	-35	-30	-25	-20	-15	-10	-5	0	
35	220V-50Hz	1,565	1,527	1,492	1,460	1,429	1,400	1,373	1,347	1,322	1,298	1,274
	240V-50Hz	1,638	1,599	1,563	1,530	1,499	1,470	1,442	1,415	1,390	1,365	1,342
40	220V-50Hz	1,744	1,708	1,674	1,642	1,613	1,586	1,560	1,535	1,512	1,490	1,468
	240V-50Hz	1,845	1,806	1,769	1,735	1,704	1,674	1,646	1,619	1,594	1,570	1,546
45	220V-50Hz	1,924	1,889	1,856	1,826	1,798	1,772	1,748	1,725	1,704	1,683	1,664
	240V-50Hz	2,054	2,014	1,976	1,942	1,909	1,879	1,851	1,825	1,799	1,776	1,753
50	220V-50Hz	2,104	2,070	2,039	2,010	1,984	1,959	1,937	1,916	1,896	1,878	1,861
	240V-50Hz	2,263	2,221	2,183	2,148	2,116	2,085	2,057	2,031	2,006	1,982	1,960
55	220V-50Hz	2,285	2,252	2,222	2,194	2,170	2,147	2,126	2,107	2,090	2,074	2,059
	240V-50Hz	2,473	2,430	2,391	2,356	2,323	2,292	2,264	2,238	2,214	2,191	2,169

Current[A]

Calculated values

Condensing Temp. °C	Power Supply	Evaporating Temp. °C										
		-45	-40	-35	-30	-25	-20	-15	-10	-5	0	
35	220V-50Hz	7.2	7.0	6.9	6.7	6.6	6.5	6.3	6.2	6.1	6.0	5.9
	240V-50Hz	7.5	7.3	7.2	7.1	6.9	6.8	6.7	6.6	6.5	6.4	6.3
40	220V-50Hz	8.1	7.9	7.7	7.6	7.5	7.3	7.2	7.1	7.0	6.9	6.8
	240V-50Hz	8.3	8.2	8.0	7.9	7.8	7.6	7.5	7.4	7.3	7.2	7.1
45	220V-50Hz	8.9	8.7	8.6	8.5	8.3	8.2	8.1	8.0	7.9	7.8	7.7
	240V-50Hz	9.2	9.0	8.9	8.7	8.6	8.5	8.4	8.3	8.2	8.1	8.0
50	220V-50Hz	9.8	9.6	9.5	9.3	9.2	9.1	9.0	8.9	8.8	8.7	8.6
	240V-50Hz	10.0	9.8	9.7	9.5	9.4	9.3	9.2	9.1	9.0	8.9	8.8
55	220V-50Hz	10.6	10.5	10.3	10.2	10.1	10.0	9.9	9.8	9.7	9.6	9.5
	240V-50Hz	10.8	10.7	10.5	10.4	10.2	10.1	10.0	9.9	9.8	9.7	9.6

NN0010271

SEALING
(SILVER SOLDER)

SEALING
SILVER SOLDER

THE INSTALLATION WAY OF BUSH VIEW B)

This exploded view diagram illustrates the assembly of a lock mechanism. The base plate is shown at the bottom, featuring a central circular hole and several mounting holes. A cover is positioned above the base plate, secured by four lock nuts. A basket is attached to the side of the base plate. A lock component, labeled 'LOCK S', is shown separately at the top right. Dimension lines indicate the following measurements: a total width of 26.8 mm, a height of 16.2 mm for the cover, and a distance of 2 mm between the top edge of the base plate and the top edge of the cover.

This technical drawing illustrates a vertical industrial unit, likely a filter or compressor assembly. The unit features a rectangular top section labeled "WARNING INDICATION" and a larger rectangular body below it. A vertical pipe extends from the top section. On the front face of the body, there is a label box containing the following text:
HITACHI
REFRIGERATING COMPRESSOR
MODEL
SERIAL NO.
MANUFACTURED
EXPIRED DATE
VALIDITY PERIOD
SPECIFICATIONS
SAFETY
INSTRUCTIONS
WARRANTY
CE
The drawing also includes several dimension lines: a total height of 303 mm, a width of 25 mm, and a depth of 150 mm. A small circular detail at the bottom right shows a cross-section of a tube and a valve. A legend in the bottom right corner defines symbols for "ACCURACY", "EQUIPMENT TESTED", "TESTS", and "TESTS NOT MADE".

This technical drawing illustrates a 6.2 ID single injection system. It features a large rectangular tank at the top with a horizontal dimension of 41.8 inches. A vertical line labeled "6.2 ID SUCTION" extends downwards from the left side of the tank. On the right side, there is a vertical pipe assembly with a valve and a circular component. The drawing also includes a small arrow pointing towards the tank and a label "φ 3 9." near the top right.

This technical drawing illustrates a threaded bolt assembly, specifically a M8 bolt (no supply) with a spring washer. The assembly includes a washer, a pipe, a foot, a rubber gasket, a unit base, and a nut (no supply). The drawing also shows a cross-sectional view of the bolt's internal threads and a detailed view of the washer and bolt head. A callout labeled 'A' provides a magnified view of the threaded section. A note at the bottom right specifies 'ENDED TIGHTENING' with a torque value of '1.0~2.0N·m'. The drawing is signed by 'R. G. C. B.' and includes a signature box.

DIMENSION : mm

ITEM A OR B)	PROJECTION	SCALE	TITLE	DATE	RECD.
COMMET	1 : 1	COMPRESSOR	TO CHIGI DWG. No.	05.05.22	Hitachi-Johnson Controls
SPRING WASHER (NO SUPPLY)	1 : 1	SKETCH	3/CYC	05.05.22	Air Conditioning, Inc.
WASHER	1 : 1				
PIPE	1 : 1				
FOOT	1 : 1				
RUBBER GROMMET	1 : 1				
UNIT BASE	1 : 1				
NUT (NO SUPPLY)	1 : 1				

CAB SKETCH

EARTH CABLE

EARTH CABLE

A detailed geological cross-section diagram of the Earth's crust. The diagram shows a series of concentric, undulating layers representing different rock types and depths. A prominent feature is a large, roughly triangular depression or basin in the center-left, bounded by thick, dark lines. To the right of this basin, several vertical dashed lines represent faults or fractures in the rock. A horizontal dashed line extends across the middle of the diagram, likely representing a specific geological horizon or depth. The word "EARTH" is written vertically along the right edge of the diagram.

1


GAD			
SIGNATURE	DATE	PROJECTION	SCALE
<u>Z. Johnson</u>	2018.05.22	(C)	1 : 1
RHO.		COMPRESSOR DIMENSION SKETCH	
		TOCHIGI DWG. NO.	
		REGD.	
Hitachi-Johnson Controls			
Air Conditioning, Inc.			
2018.05.22			

2L20100NN


Compressor model
DS1836S1

SEALING

(SILVER SOLDER)



THE INSTALLATION
WAY OF BUSH
(VIEW A)

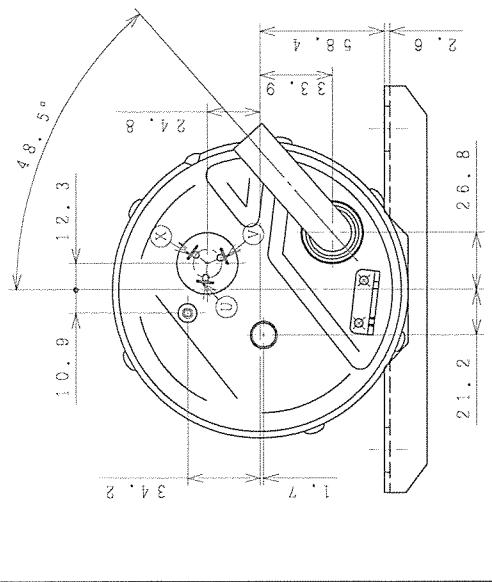


391

308

2.5

φ 2.1





HERMETIC COVER

THE INSTALLATION
WAY OF BUSH
(VIEW B)

16.1 ID SUCTION

6.2 ID INJECTION

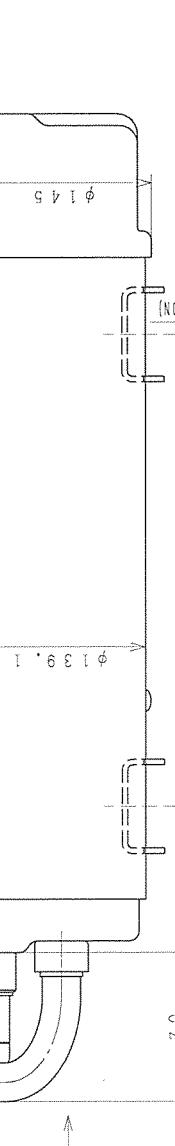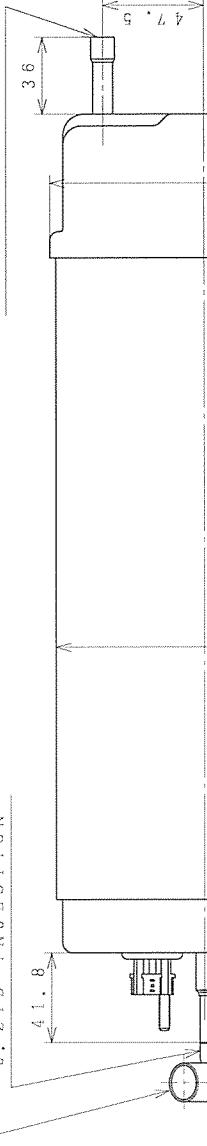

M8 BOLT (NO SUPPLY)

SPRING WASHER

WASHER

PIPE

FOOT

RUBBER GROMMET

UNIT BASE

NUT (NO SUPPLY)


A MOUNTINGS (EITHER A OR B)

B

DIMENSION : mm



EARTH STRUCTURE
(VIEW A) (NTS)



EARTH STRUCTURE
(VIEW A) (NTS)



GASKET HERMETIC COVER SETTING EARTH STRUCTURE
(VIEW A) (NTS)




GASKET HERMETIC COVER SETTING EARTH STRUCTURE
(VIEW A) (NTS)

SIGNATURE	DATE	PROJECTION	SCALE	TITLE
K. S. Sripada	2018.05.22	④ -	NTS	COMPRESSOR DIMENSION SKETCH
DN.		④ -	NTS	
Z. Ohigawa	2018.05.22			TOUCHI DWG. No.
CHD.				REGD.
APPD.				Hitachi-Johnson Controls, Inc.
M. Ongudi	2018.05.22			Air Conditioning, Inc.

CAD
REGD.
TOUCHI DWG. No.
Hitachi-Johnson Controls, Inc.
Air Conditioning, Inc.
3 CYC NNN00100272

819140088

SINGLE-PHASE POWER

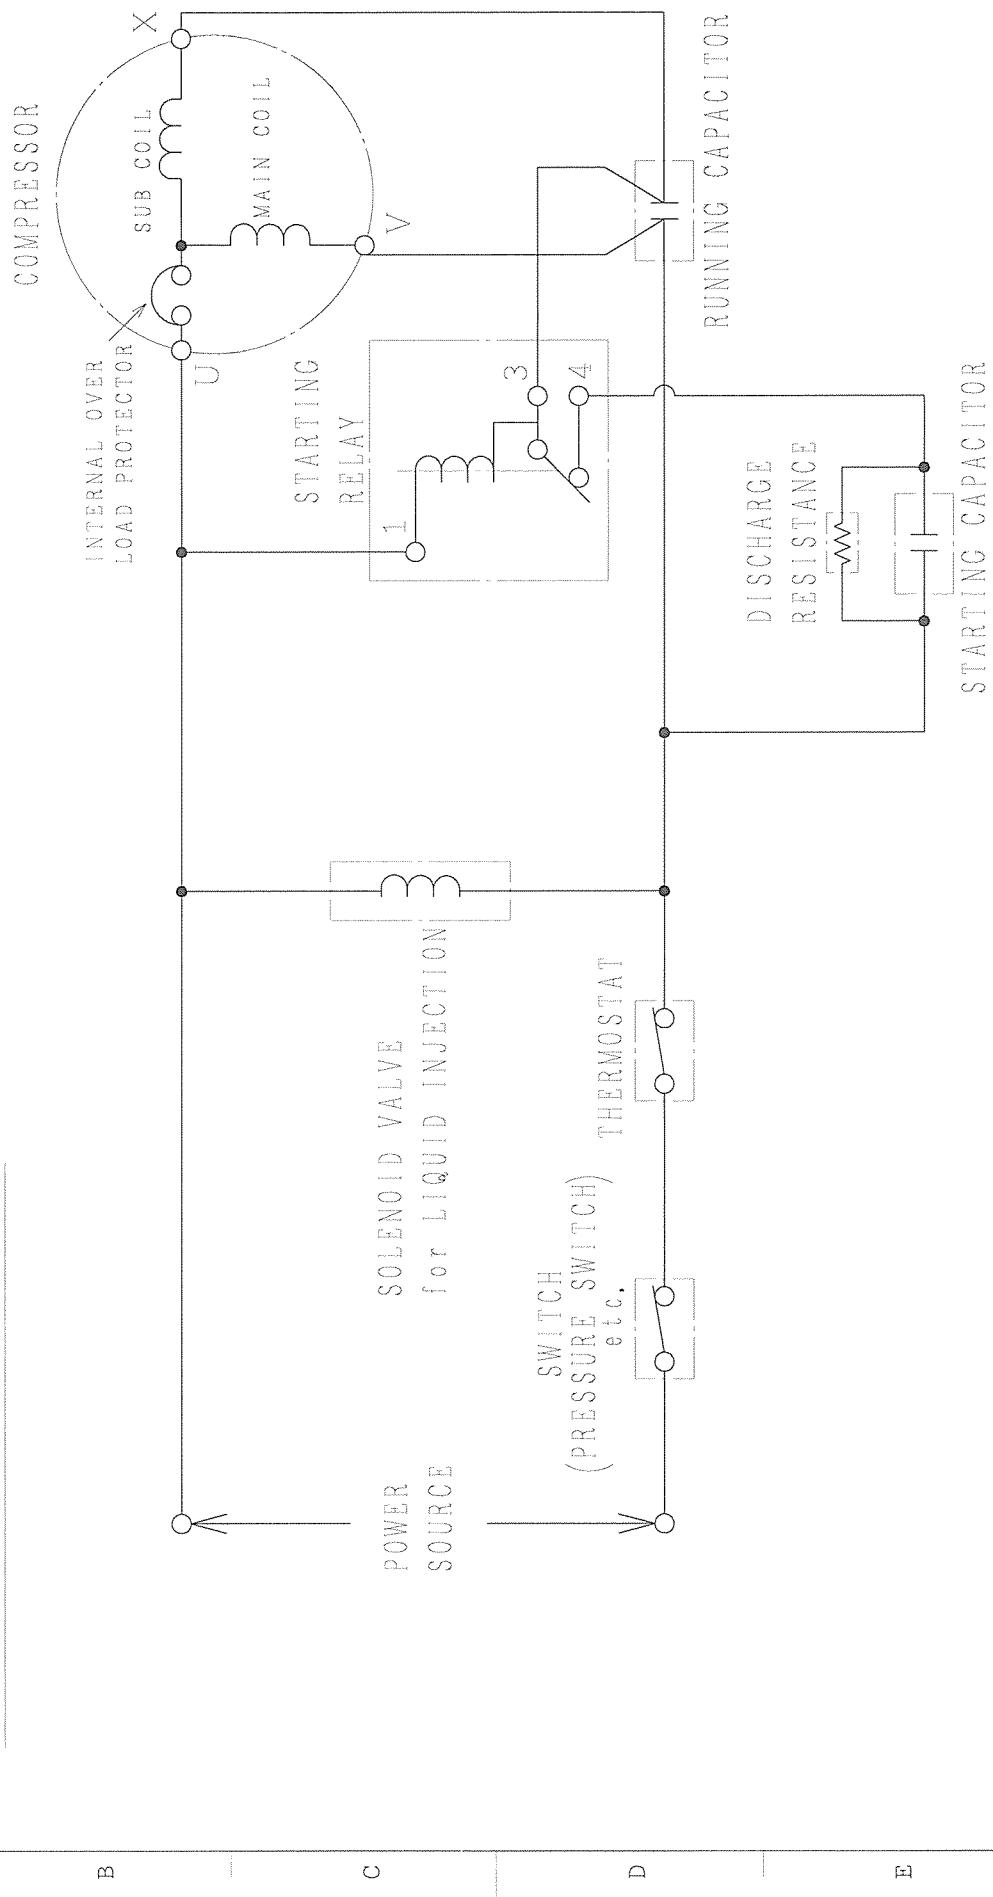


CIRCUIT DIAGRAM			
SIGNATURE	DATE	SCALE	TITLE
DW. K. Hatt	2013-11-26	@ NTS	TOCHIGI DWG. No.
CHD. K. Matsunaga	2013-11-26		Hitachi-Johnson Controls
APD. M. Ooguchi	2013-11-26		Air Conditioning, Inc.
			3 CYC BB0041918

REGD	
2013	1128
2013	1128
2013	1128

3CYCA6131


CONDENSER

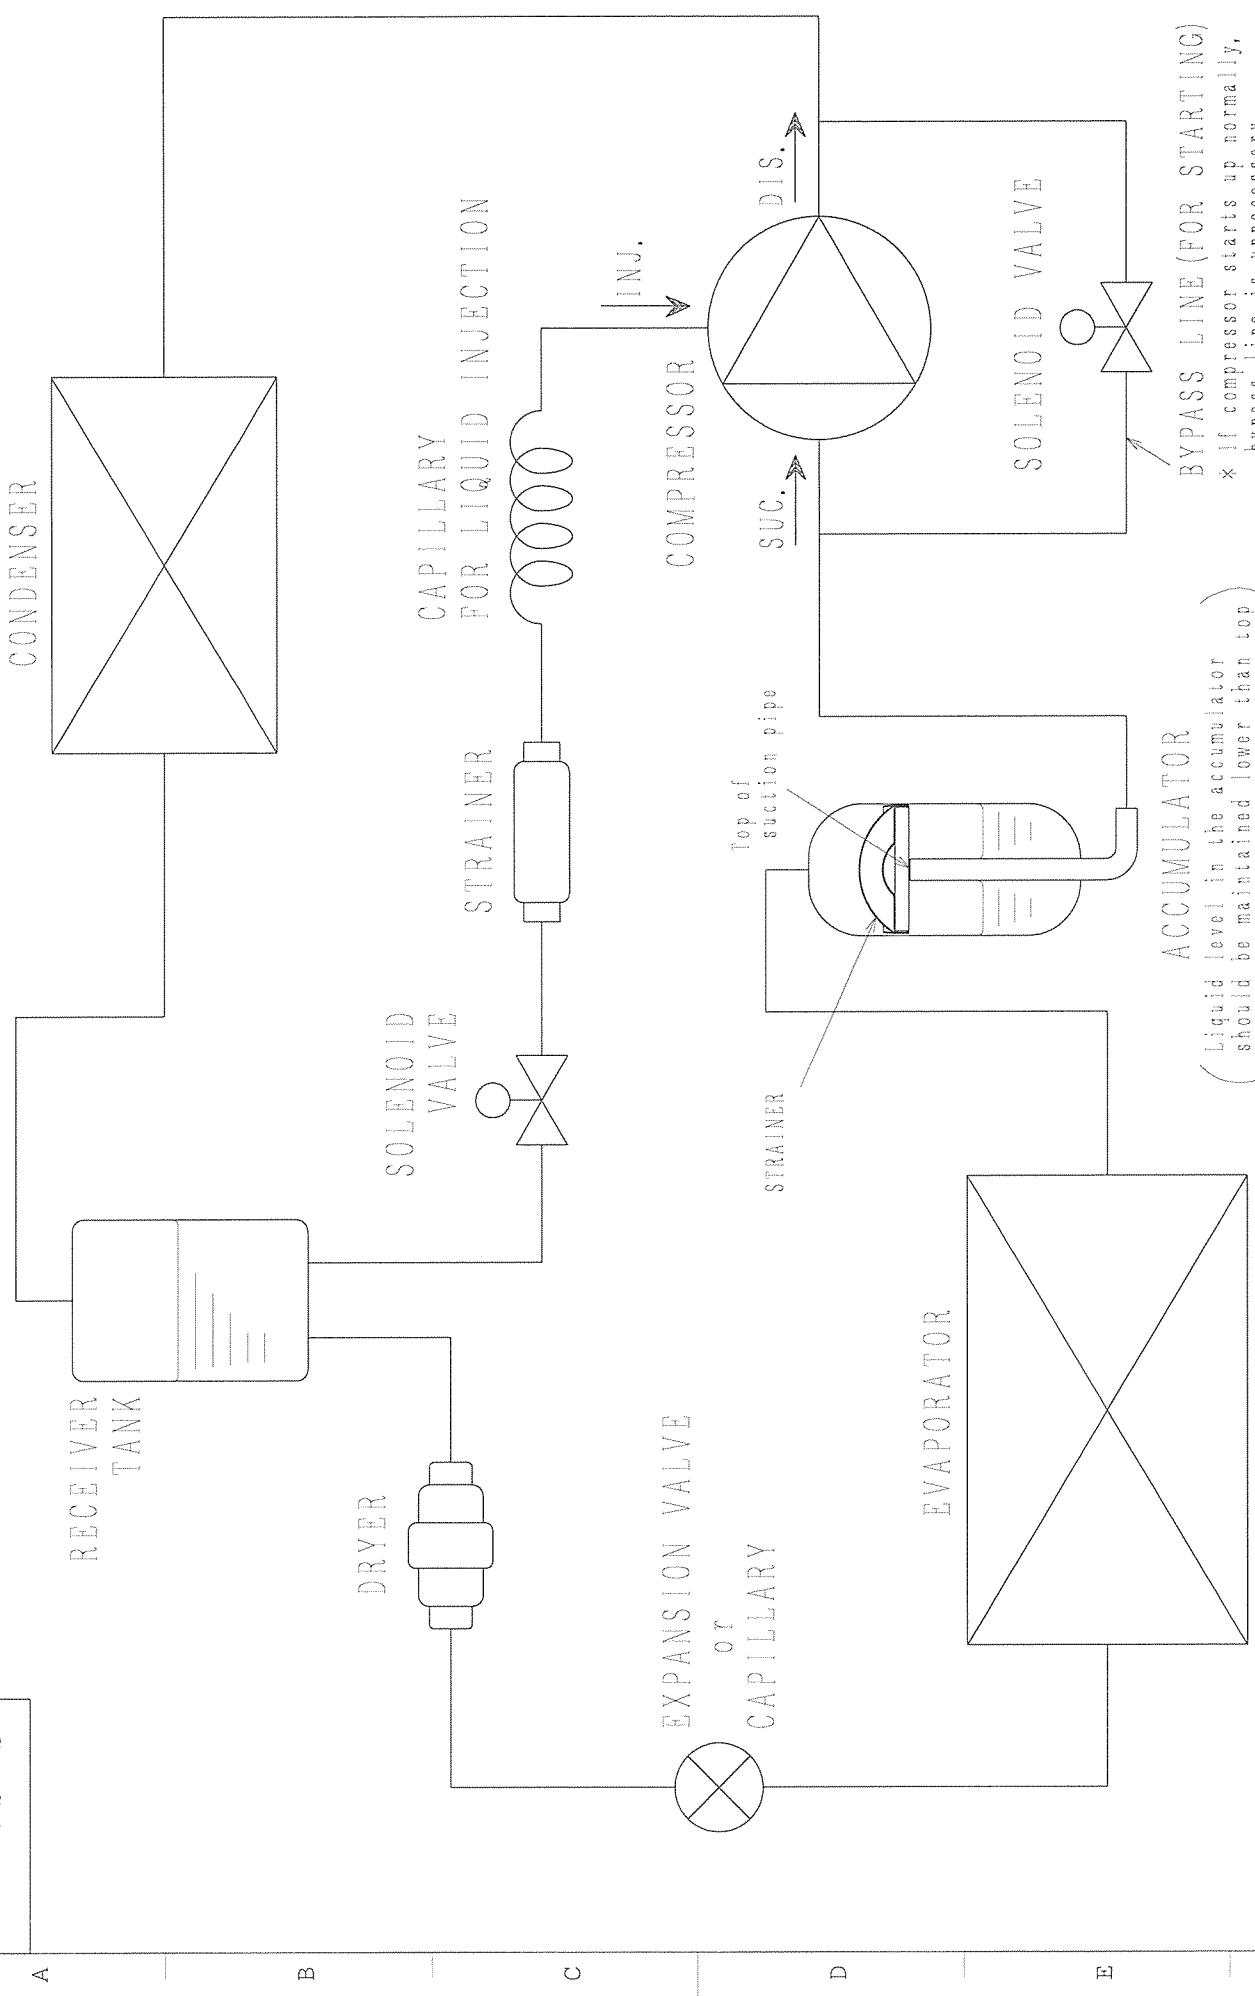


ACCUMULATOR
 (Liquid level in the accumulator should be maintained lower than top of suction pipe in the accumulator.)

BYPASS LINE (FOR STARTING)
 * If compressor starts up normally, bypass line is unnecessary.


REFRIGERATION SYSTEM			
SIGNATURE	DATE	PROJECTION	SCALE
DRW. M. Obayashi	2004-05-31	◎	1 : 1
CHRO. S. Tagawa	2004-05-31	TOCHIGI DWG. No.	
APPD. S. Tagawa	2004-05-31	Hitachi-Johnson Controls Air Conditioning, Inc.	
		REGD. 2004 0602	



The accumulators should be connected between discharge pipe of evaporator and suction pipe of compressor. The allowable incline should be less than 5° . The two accumulators should be connected in series like the figure.

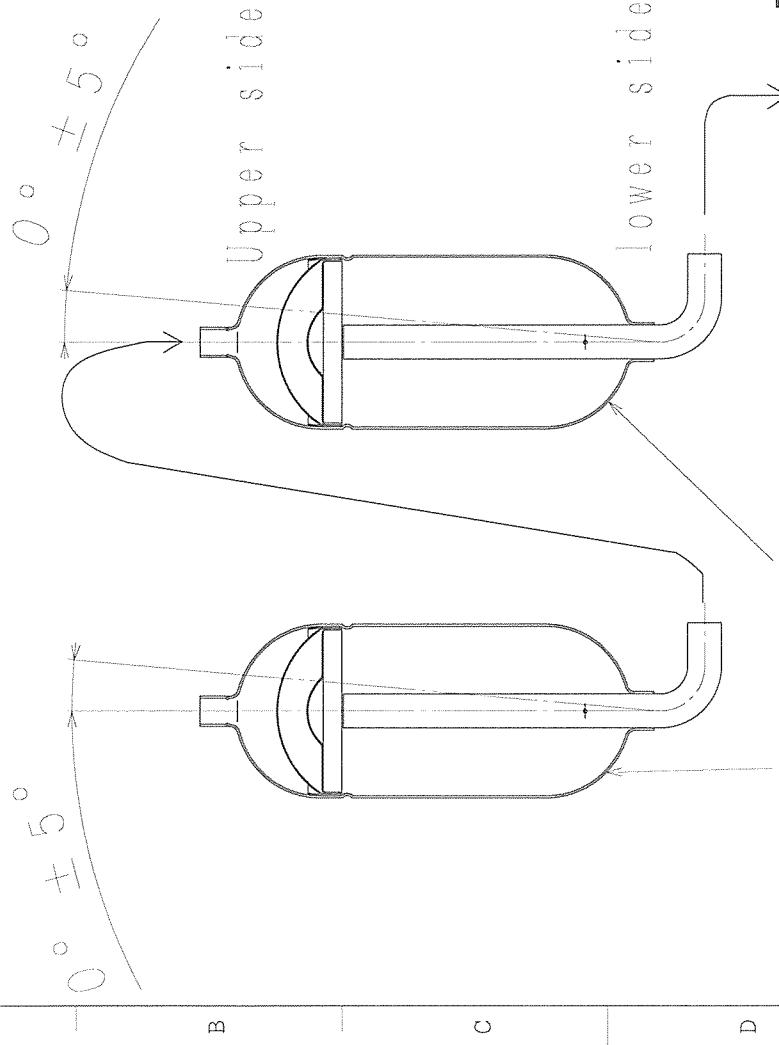

COMPRESSOR

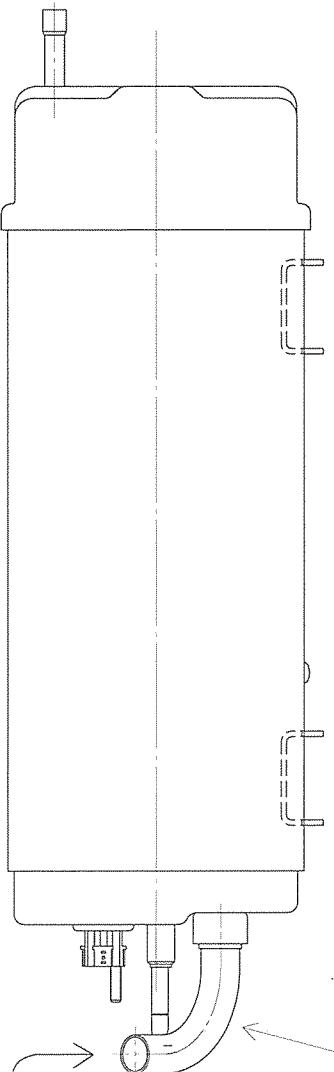

Succinct pipeline of compression

SIGNATURE	DATE	PROJECTION	SCALE	TITLE	CONNECTING SKETCH OF ACCUMULATOR
M. Nishida	2004-05-26	(C)	1 : 2		
M. Onoguchi	2004-05-26			Hitachi-Johnson Controls Air Conditioning, Inc.	TO CHIC! DWG. No. 30CYCA6121
MAPPD. S. Tadawa	2004-05-26				

CAD

10

୧୮

22

6
ING SKETCH



COMPLAINT

101


A01Z1

B
B
0
0
4
4
5
8

A

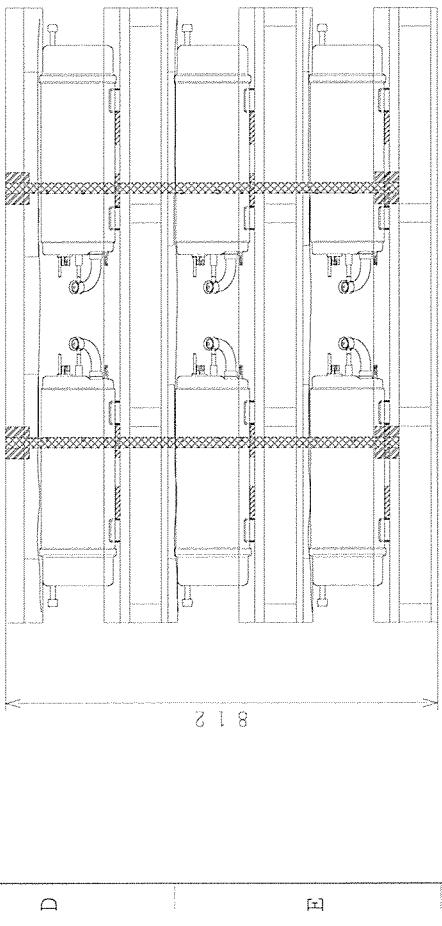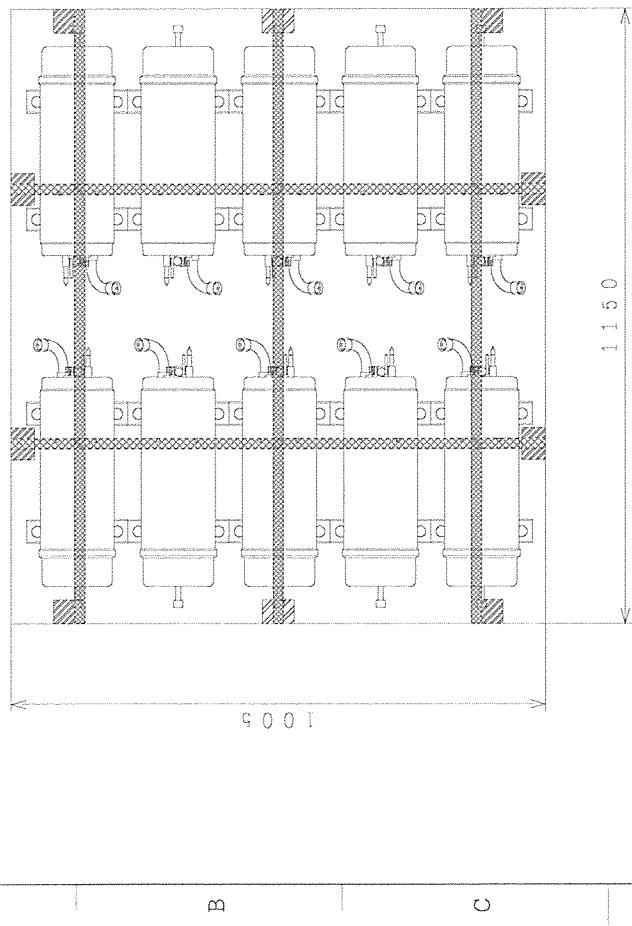

MODEL	INCLINED NUMBER	NUMBER OF STEPS	GROSS WEIGHT (kg)
DS1836S1	30	3	760
DS1529S1			
DS1529V1	30	3	760
DS1529X1			
DS1834S1			
DS1834V1	30	3	760
DS1834X1			
DS2244V1	30	3	790

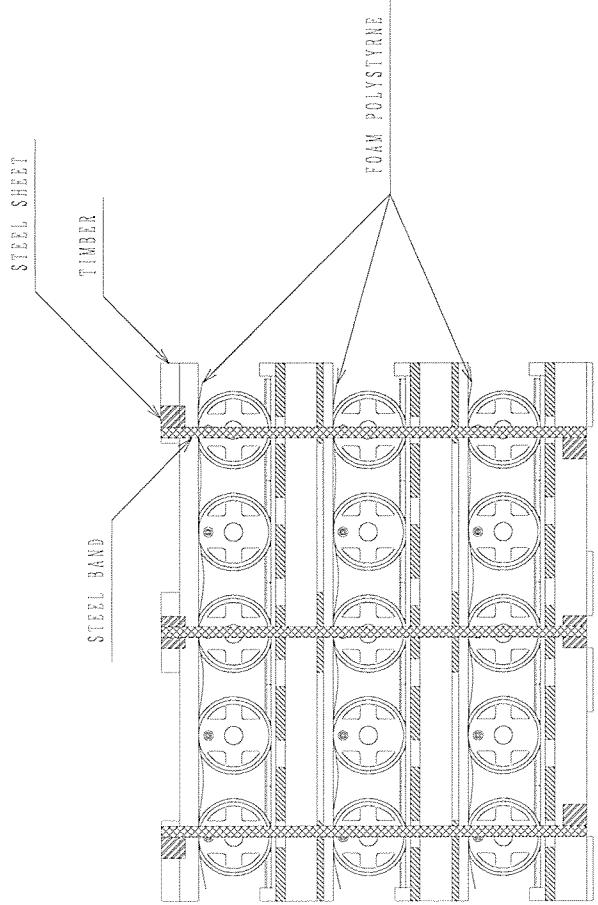


TITLE			
DS COMPRESSOR PACKING SKETCH			
SIGNATURE	DATE	SCALE	PROJECTION
DWN. K. Iida	2014-04-28	1 : 10	(C)
CHAO. X. Matsunaga	2014-04-28		
Hitachi-Johnson Controls		TOCHIGI DWG. No.	REGD
Air Conditioning, Inc.		3 CYC BB004458	2014-04-28
APPD. M. Ondaci	2014-04-28		

CAD


RECD

654400BB

A

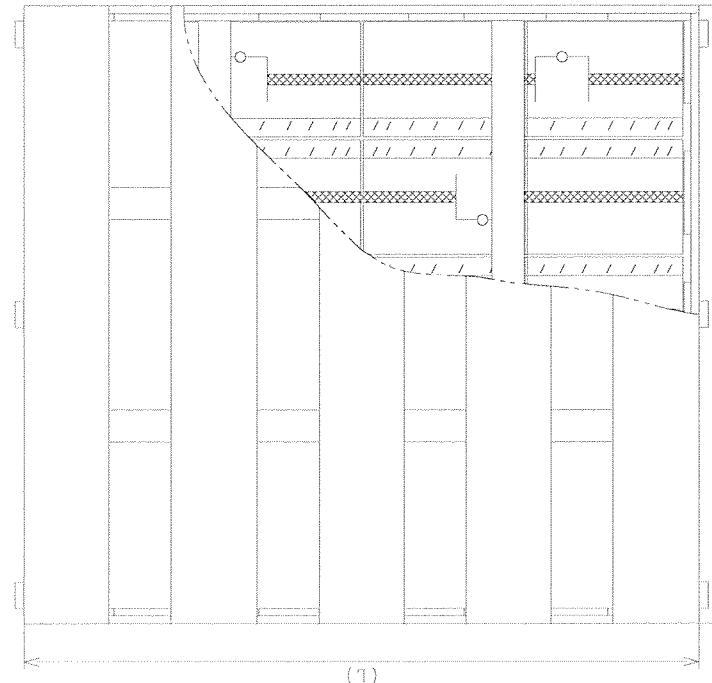


A

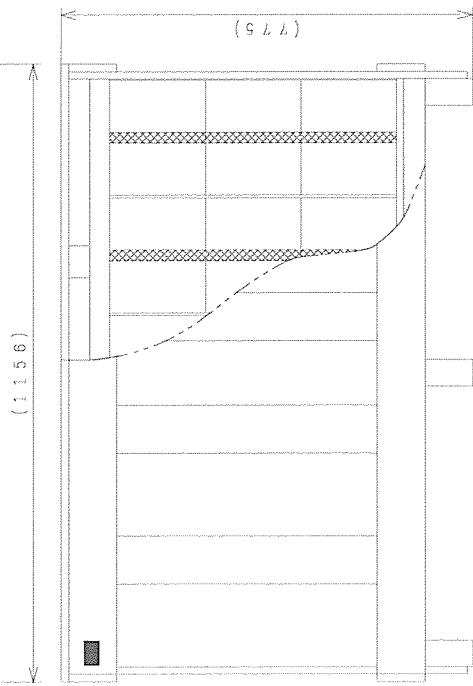

D

MODEL	INCLUDED NUMBER	NUMBER OF STAGES	L	GROSS WEIGHT (kg)
DS1836S1	30	3	1266	770
DS1529S1	30	3	1266	770
DS1529V1	30	3	1266	770
DS1529X1				
DS1834S1				
DS1834V1	30	3	1266	770
DS1834X1				
DS2244V1	30	3	1366	810

MODEL	INCLUDED NUMBER	NUMBER OF STAGES	L	GROSS WEIGHT (kg)
DS1836S1	30	3	1266	770
DS1529S1	30	3	1266	770
DS1529V1	30	3	1266	770
DS1529X1				
DS1834S1				
DS1834V1	30	3	1266	770
DS1834X1				
DS2244V1	30	3	1366	810

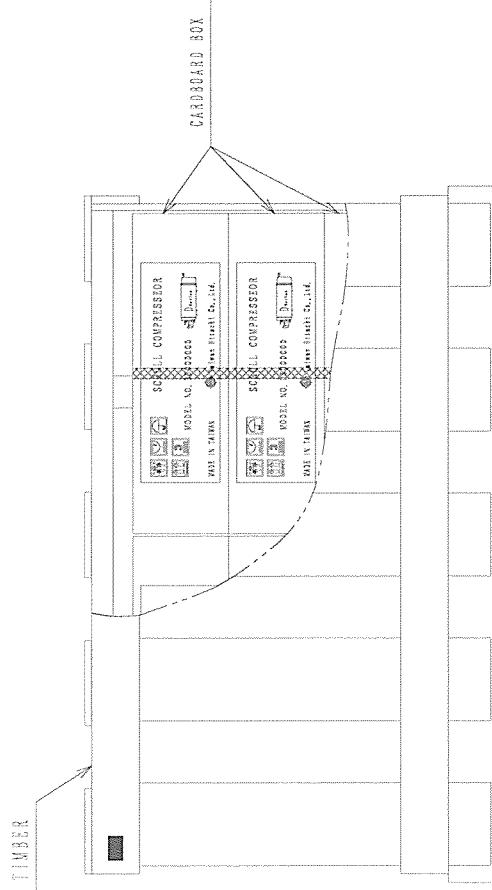


E

SIGNATURE		DATE	PROJECTION	SCALE	TITLE
DWY, K. Haba		2014-04-29	(@)	1 : 10	DS COMPRESSOR PACKING SKETCH
CHD, K. Matsunaga		2014-04-29			Hitachi-Johnson Controls
APPD, M. Onodera		2014-04-29			Air Conditioning, Inc.
3 CYC BB004459					

REGD
2014
0429

CAP

3 CYC6299

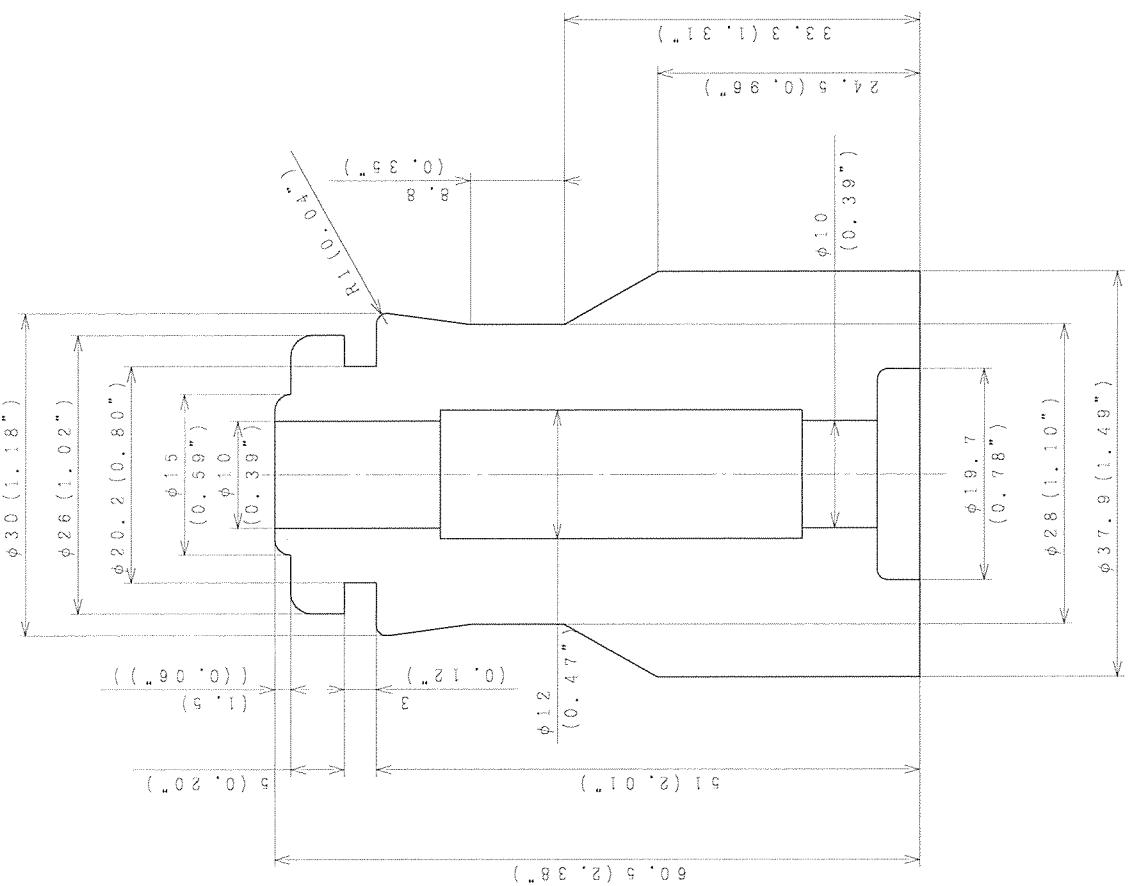

MATERIAL : NATURAL RUBBER

COLOR : BLACK

DIMENSION : mm (in)


SIGNATURE	DATE	PROJECTION	SCALE	TITLE
DW, Y.Watada	1992-05-13	④	2 : 1	RUBBER GROMMET
CHKD, K.Sekiuchi	1992-05-13			TOCHIGI MFG. No.
APPD,Y.Serizawa	1992-05-13			Hitachi-Johnson Controls Air Conditioning Inc.

REGD
0515

3 CYC62866

F



4CYC11219

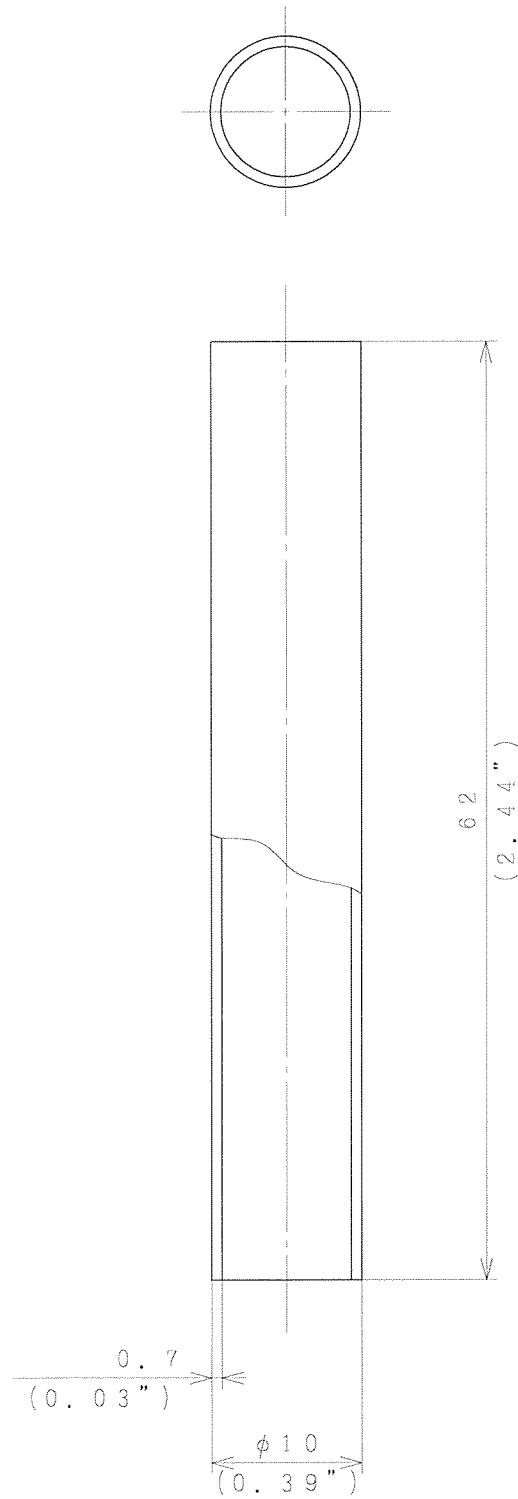

MATERIAL : STEEL PIPE
DIMENSION : mm (in)

SIGNATURE	DATE	PROJECTION	SCALE	TITLE	CAD
DWN. P.Nishioka	2003-10-27	(◎)	2 : 1	PIPE	
CHKD. M.Onoguchi	2003-10-28			TOCHIGI DWG. No.	RECD.
APPD. A.Simada	2003-10-29	Hitachi-Johnson Controls Air Conditioning, Inc.		4CYC11219	RECD 2003 1104

4CYC11220


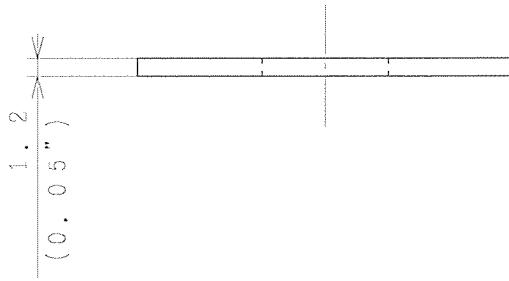
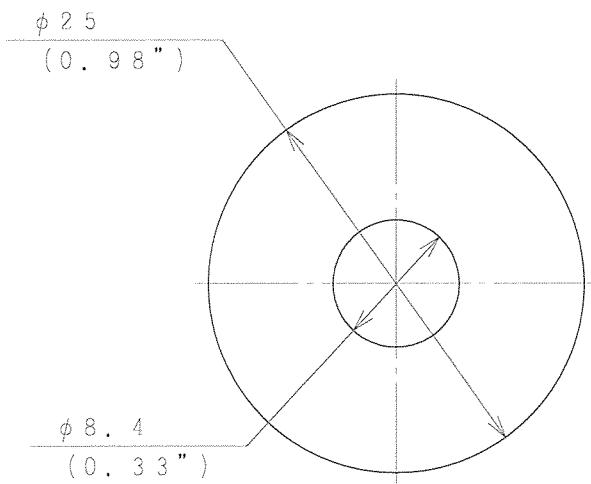


NOTES

MATERIAL : COLD ROLLED CARBON STEEL SHEETS
AND STRIP
SURFACE : ZINC-COATED
DIMENSION : mm (in)

SIGNATURE	DATE	PROJECTION	SCALE	TITLE	CAD
DWN. P. Nishioka	2003-10-27	(◎)	2 : 1	WASHER	
CHKD. M. Onoguchi	2003-10-28			TOCHIC1 DWG. No.	RECD.
APPD. A. Simada	2003-10-29	Hitachi-Johnson Controls Air Conditioning, Inc.		4CYC11220	REGD. 2003 1104

B0041336

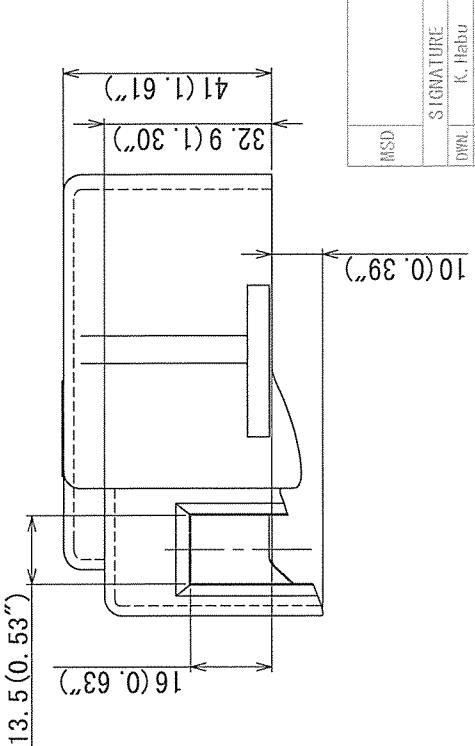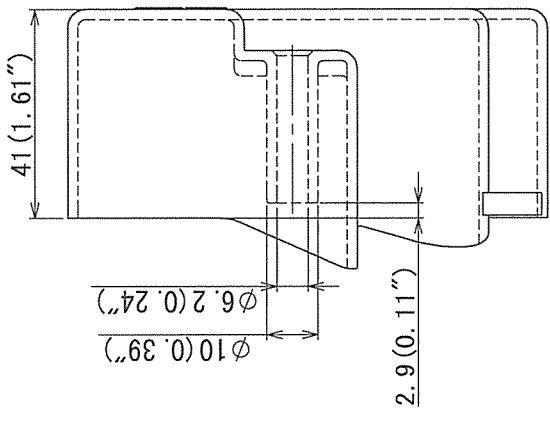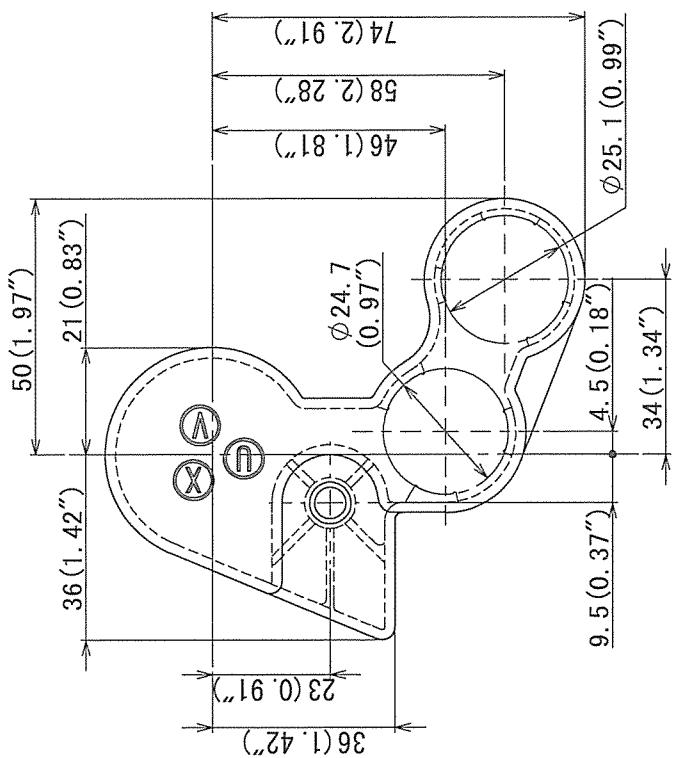

DIMENSION:mm(in)


MSD	SIGNATURE	BATE	PROJECTION	TITLE
BRN	K. Habu	2013-10-17	④	3DCAD
CHEK	K. Matsunaga	2013-10-17	SCALE	
APRJ	M. Onoguchi	2013-10-17	1:1	

UL Flame Class: 94-5V or Equivalent

3CYC BB0041336		REGD 2013 10/17	004
Hitachi-Johnson Controls Air Conditioning, Inc.		TOCHIGI DWG. NO.	

This drawing is under license by Johnson Controls-Hitachi Air Conditioning Technology (Hong Kong) Limited
5

3CYCA499

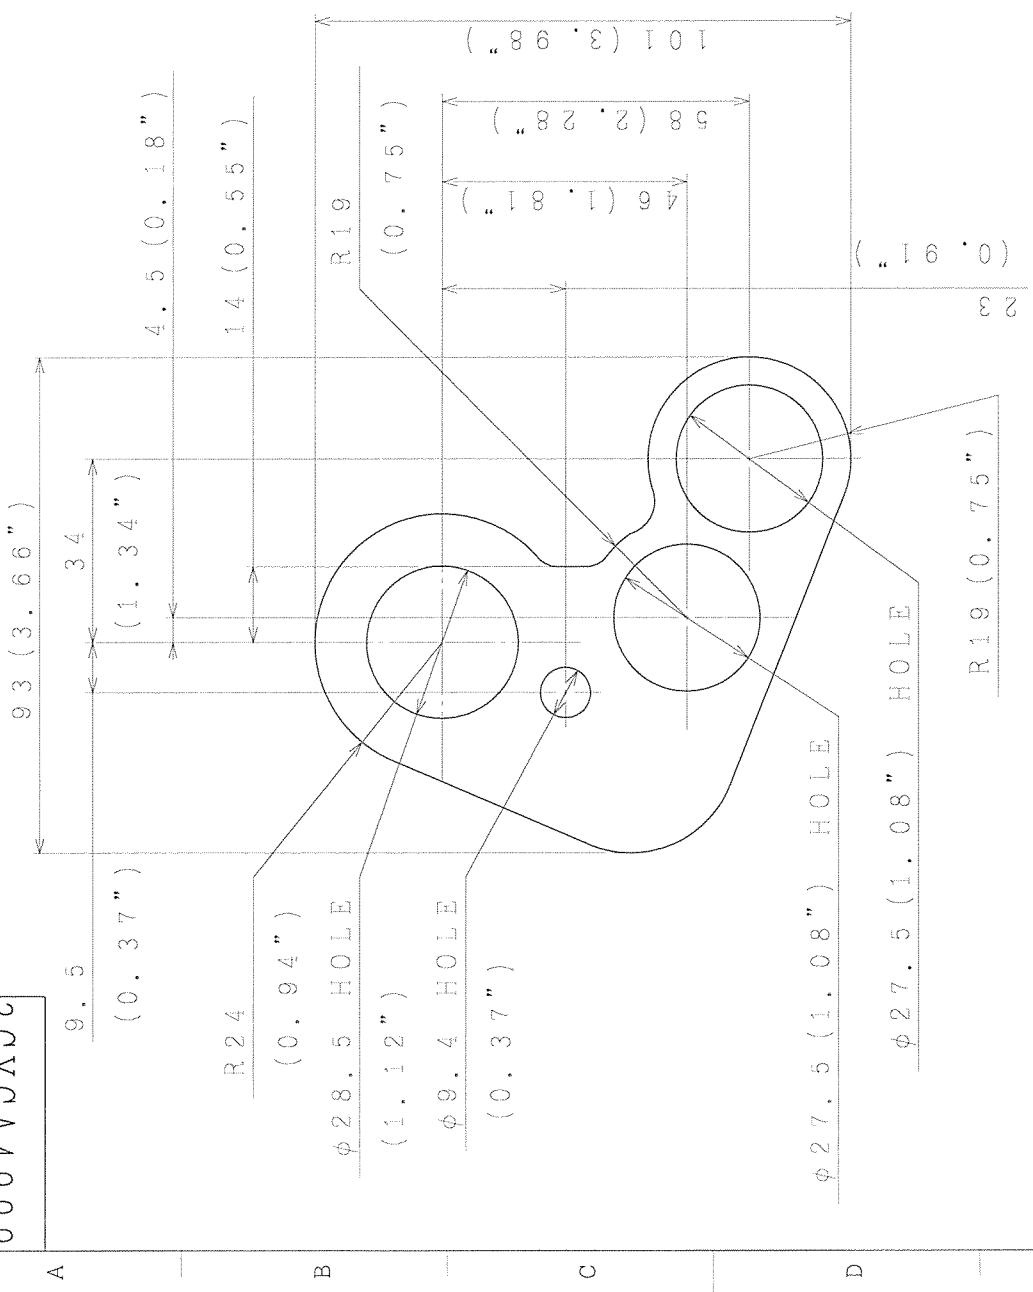

DIMENSION: mm (in)			
SIGNATURE	DATE	SCALE	TITLE
DW. M. Aoyama	2003-0-28	1 : 1	RUBBER PLATE
CHOU, M. Ooguchi	2003-10-28	1 : 1	TOUCH! DWG. No.
APPD. A. Simida	2003-10-29	1 : 1	Hitachi-Johnson Controls Air Conditioning, Inc.
		REGD.	3 CYCA499
		2003	1004

F

3CYC62897

A


B

C

D

E

F

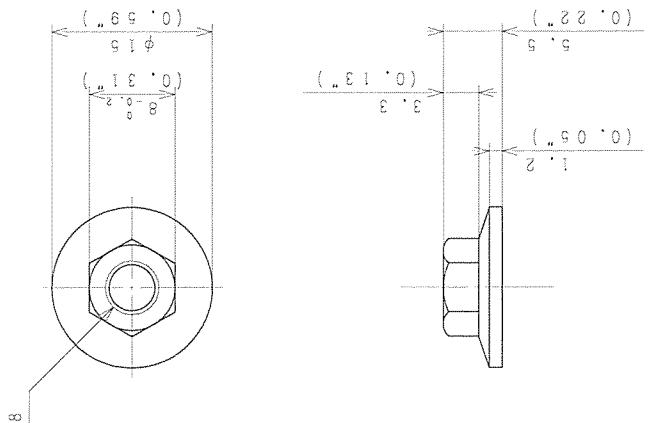


MATERIAL : SWRM6

DIMENSION : mm (in)

SIGNATURE	DATE	PROJECTION	SCALE	TITLE	RECD
DW, V. Nakada	1992-05-13	④-	2 : 1	NUT	TOCHIGI DWG. No.
CHQ, K. Sekiguchi	1992-05-13			Hitachi-Johnson Controls	REGD
APP, V. Segizawa	1992-05-13			Air Conditioning, Inc.	1992 0515

THIS DRAWING IS THE PROPERTY OF HITACHI-JOHNSON CONTROLS AIR CONDITIONING, INC., AND IS TO BE RETURNED UPON REQUEST.

B B 0 0 7 0 2 1

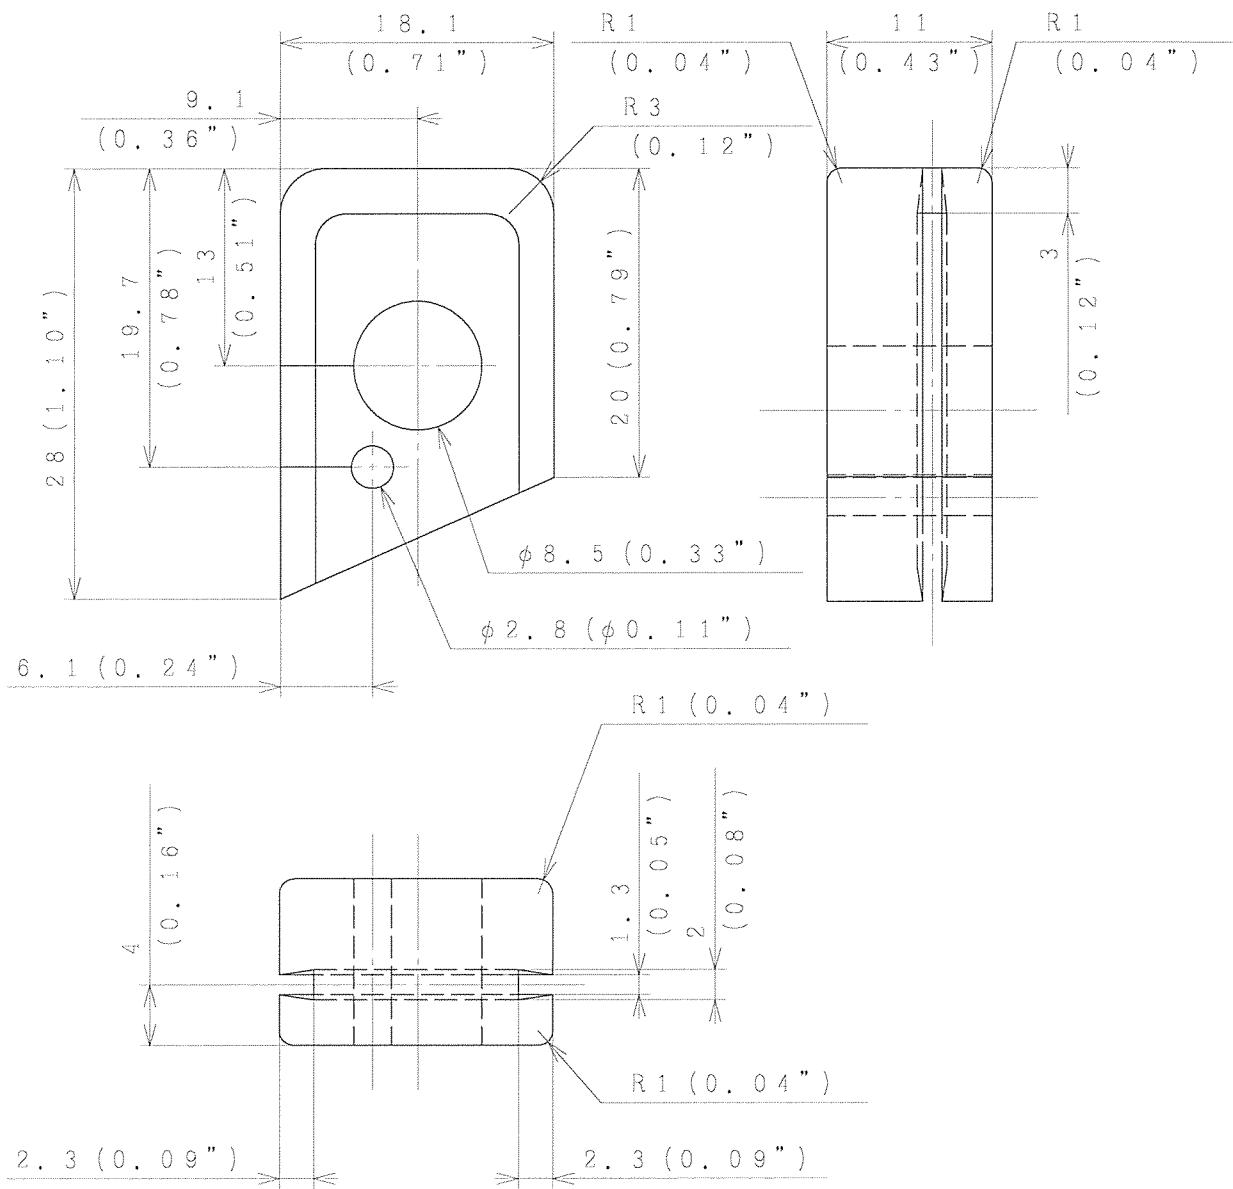

MATERIAL: EPDM

DIMENSION: mm (in)

SIGNATURE	DATE	PROJECTION	SCALE	TITLE	RECD.
DWN. W. Sugawara	2007-02-22	(C)	2 : 1	BUSH	RECD.
CHKD. M. Onoguchi	2007-02-22			TOCHIGI DWG. No.	RECD.
APPD. A. Simada	2007-02-22			Hitachi-Johnson Controls Air Conditioning, Inc.	2007 0223

This drawing is under license by Johnson Controls-Hitachi Air Conditioning Technology (Hong Kong) Limited

002

B0000406

R - Label (E - BOX Type: C, D, E only)

You must REPLACE with RELAY
of the following characteristics
when using flammable refrigerant.


Necessary characteristics

Conforming to the ATEX directive

• PICKUP VOLTAGE: 10V TO 152V

• DROP-OUT VOLTAGE: 90V MAX

• CONTACT RATING: 20A BREAK 200,000 OPERATIONS

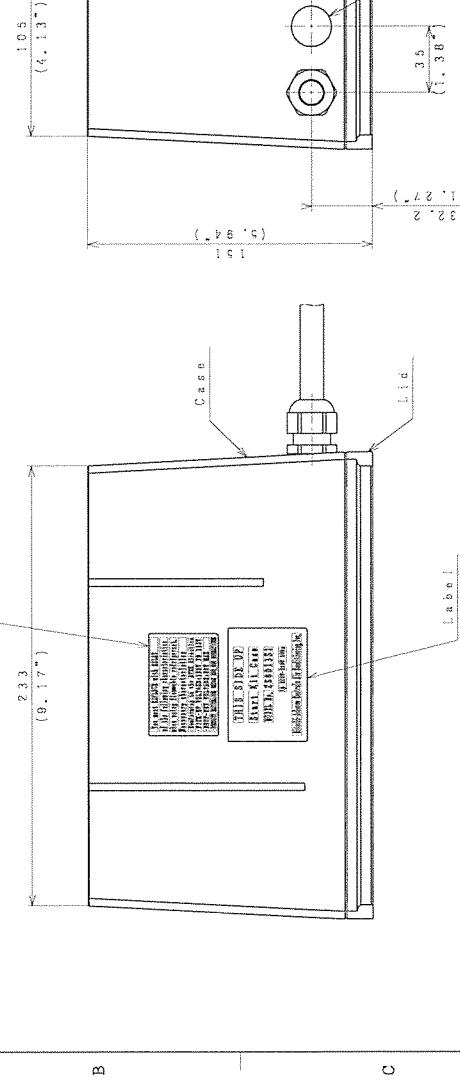

Label

THIS SIDE UP

Indicate compressor
type number and
installation direction

Comp. Model: ZSxxxxxx

Power source:

1φ 220V-240V 50Hz

Leadwire: 1.2 SQ

AMP #250

Fasteron receptacle


AMPL-250V

50Hz


400V

3CYCA4981

A

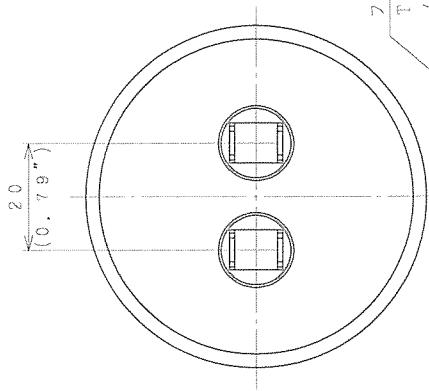

B

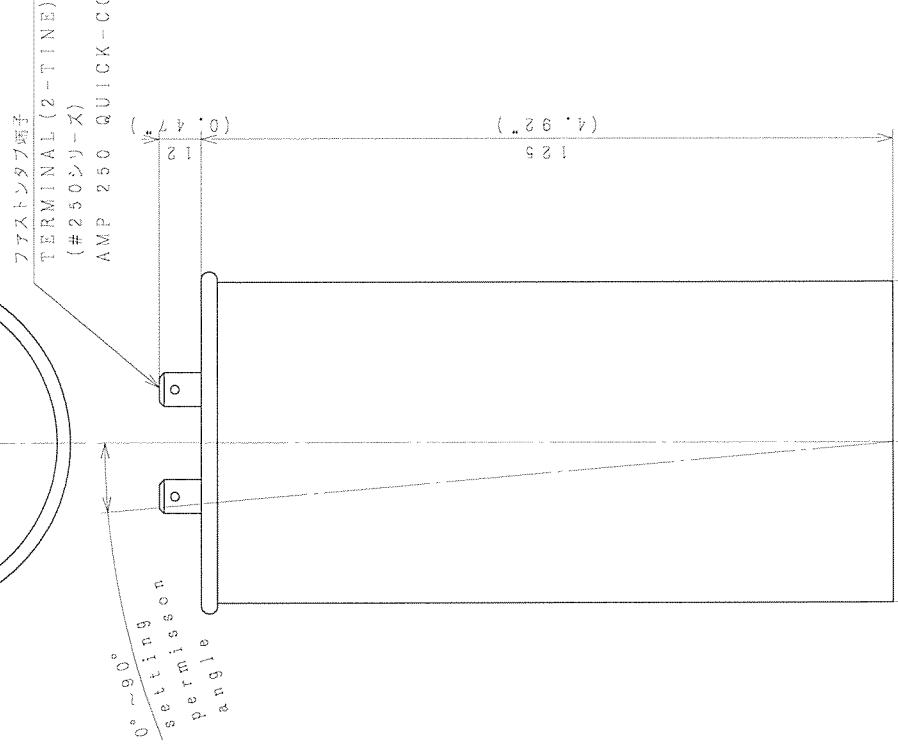

TERMINAL (2-TINE)
(#250シリーア)
AMP 250 QUICK-CONNECT

setting
permission
angle

RUNNING CAPACITOR 運転用キャパシタ

1. TYPE 積層
METALLIZED FILM CAPACITOR

メタリズド フィルム コンデンサ
2. SPECIFICATION 性様

CAPACITOR			
CAPACITANCE 容量 MFD	VOLTAGE 電圧 V, AC	FREQUENCY 周波数 Hz	
5.5 ⁺⁴ ₋₂	450	50/60	

D

E

F

φ60.8
(2.93")

GAP	
SIGNATURE	DATE
DW. E.Nishioke	2003-10-30
CHK. M.Ooguchi	2003-10-30
APP. A.Simata	2003-10-30
PROJECTION	SCALE
◎	1 : 1
RUNNING CAPACITOR	
TOCHI-Johnson Controls	REGD
Hitachi-Johnson Controls, Air Conditioning, Inc.	2003 2004
3CYCA4981	

EL2010NN

A

SPECIFICATION

RELAY TYPE	AMVL-240V1
FREQUENCY	50Hz
NOMAL VOLTAGE	AC 240V
OPERATING VOLTAGE	AC 140±10V
RECOVERY VOLTAGE	AC 900V or less
CONTACT CAPACITY	20A
CONTACT TYPE	type b

B

C

リレー設置方向を守つて使用下さい。
図示方向と異なる向きに取付けると正常に作動しない恐れがあります。

1. Please keep the direction of the installation of the relay. There is a case not to operate normally when installing in the direction which is different from the direction.
2. You must REPLACE with RELAY of the following characteristics when using flammable refrigerant.

Necessary characteristics

- Comforming to the ATEX directive
- PICK-UP VOLTAGE (OPERATING VOLTAGE) : 130V TO 153V
- DROP-OUT VOLTAGE (RECOVERY VOLTAGE) : 90V MAX
- CONTACT RATING (CONTACT CAPACITY) : 20A BREAK 200,000 OPERATIONS

R1270等可燃性冷媒を使用する場合は、ATEX適合に適合した、下記特性の始動リレーに交換すること。


特性

- 動作電圧: 130~153V
復帰電圧: 90V以下
接点耐久: 20A - 20万回

*CONTACT TYPE b (ON-OFF)




CIRCUIT DIAGRAM

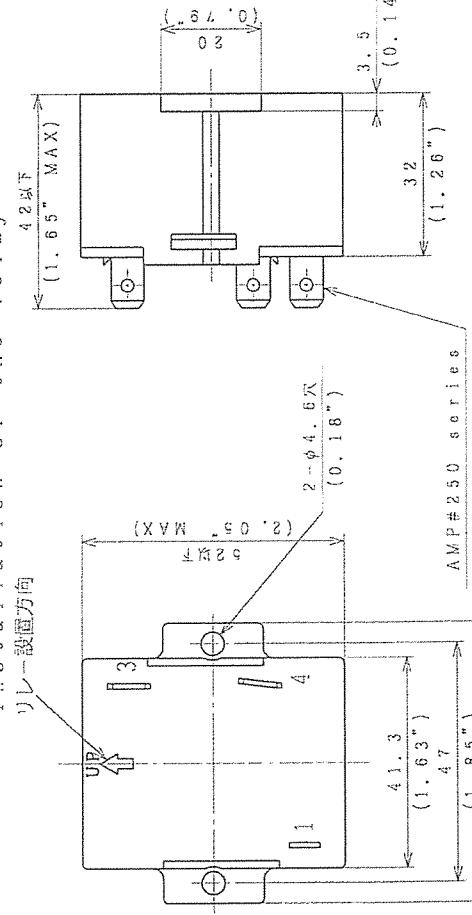

D

リレー設置方向

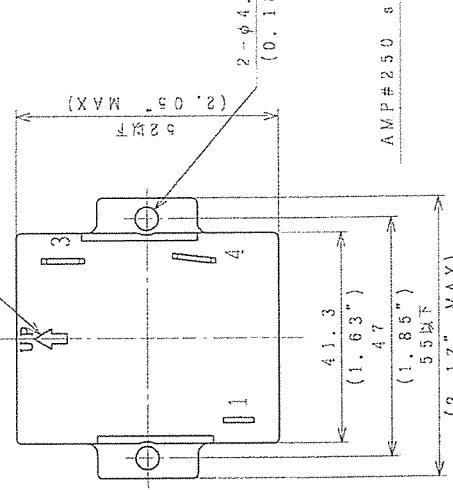

E

SIGNATURE	DATE	PROJECTION SCALE	TITLE
<i>H. Takemoto</i>	20/8/05	1:1	STARTING VOLTAGE
DWG. <i>Z. Akifusa</i>	20/8/05	1:1	CONTROL RELAY
CHG. <i>Z. Akifusa</i>	20/8/05	1:1	TOUCHIGI DWG. No.
REGD. Hitachi-Johnson Controls			
APP. M.R. Original/20/8/05, 25			Air Conditioning, Inc.
3 CYC NN0010273			

F





B B 0 0 3 2 6 8 2

A

B

C

D

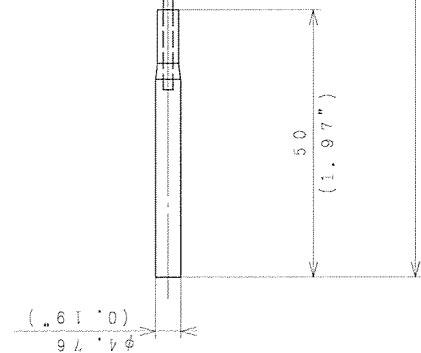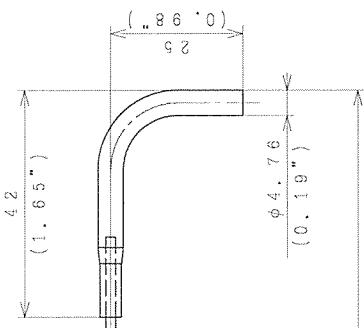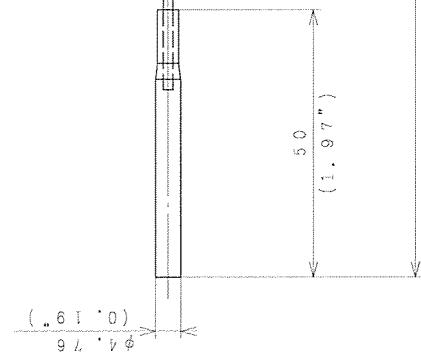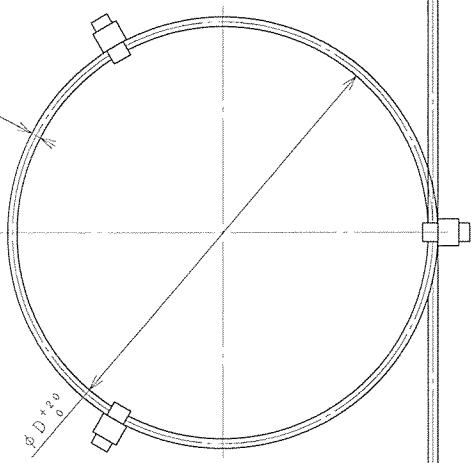 $\phi 0.681 \text{ ID} \times \phi 1.8 \text{ OD}$
 $(0.03" \text{ ID} \times 0.07 \text{ OD})$


TYPE	RESISTANCE VALUE	L	φ D	NUMBER OF TURNS
A	79.8 kPa	250 (9.84")	45 (1.77")	19
B	13.3 kPa	155 (6.10")	47 (1.85")	1
C	26.6 kPa	206 (8.11")	71 (2.80")	2
D	53.3 kPa	246 (9.69")	77 (3.03")	6
E	39.9 kPa	206 (8.11")	77 (3.03")	4
F	6.67 kPa	142 (5.59")	10 (0.39")	1

DIMENSION : mm (in)			
SIGNATURE	DATE	PROJECTION	SCALE
DNN. K. Itoigawa	2012-05-10	④ -	NTS
CHKD. M. Onoguchi	2012-05-10	④ -	NTS
APPD. A. Simata	2012-05-12	④ -	NTS
Hitachi-Johnson Controls Air Conditioning, Inc.			
3CYCBBO032682			
REGD. 2012 05/12			
CAD			

3 CYCA4165

A


B

C

D

NOTES

1. RESISTANCE VALUE : 2.67 KPa
(THE LENGTH OF THE PIPE IS APPROXIMATELY 72 (2.83") MILLIMETERS.)

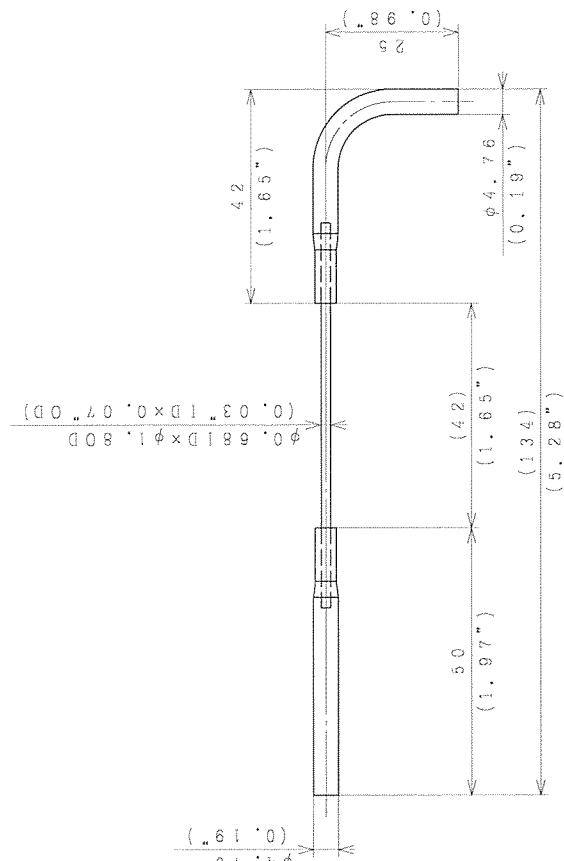



DIMENSION: mm (in)

DIMENSION: mm (in)				GAP
SIGNATURE	DATE	PROJECTION	SCALE	TITLE
DKN. A. Murakami	2003-04-14	④	1 : 1	CAPILLARY FOR LIQUID INJECTION
CHG. M. Kotani	2003-04-14			TOUGH DWG. No.
APP. V. Nakada	2003-04-14			RECD 2003 0415 Hitachi-Johnson Controls Air Conditioning, Inc. 3 CYCA4165

3CYCA5055


A

UPPER SIDE

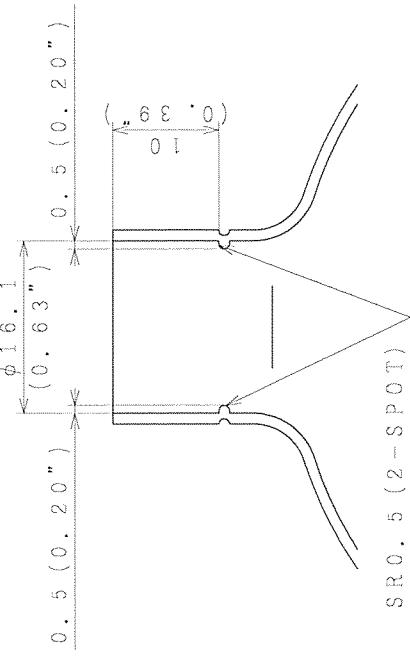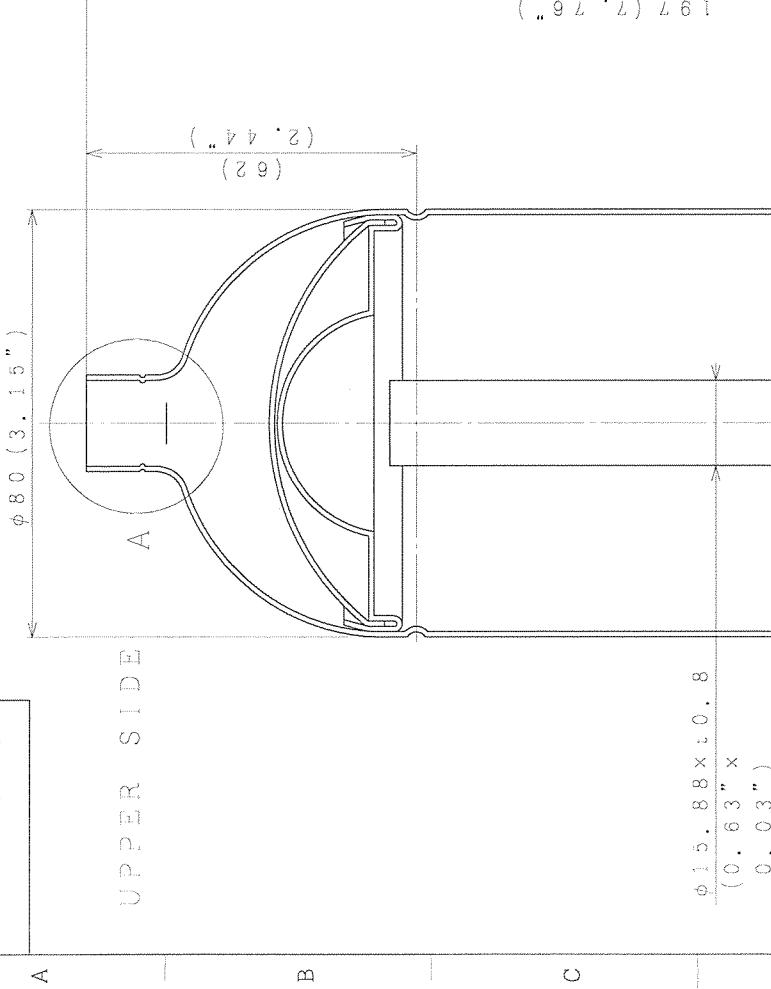

A (2 : 1)

Mesh parts

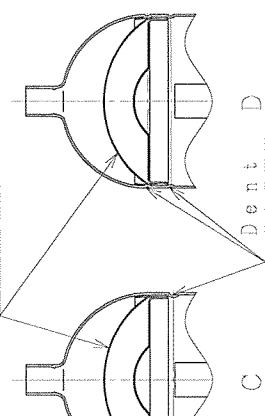

Dent for fixing the mesh parts (C or D)

VALID VOLUME: 530 mL

Note

1. Use to stand upper A side vertically.
 2. The phosphor copper brazing being done while blowing or being full of N₂ gas.
 3. The total number: 2 pieces (Total valid volume: 1060 mL)
Use to connect accumulators in series.
- DIMENSION:mm(in)

ACCUMULATOR			
SIGNATURE	DATE	PROJECTION	SCALE
DWG. F. Nishida	2003-11-05	④	1:1
CHD. M. Onoguchi	2003-11-05		
APD. A. Simada	2003-11-05		

REGD. NO. 3CYCA5055

TOCHI-JOHNSON CONTROLS
Hitachi-Johnson Controls
Air Conditioning, Inc.

REGD. NO. 3CYCA5055

1003 1106